


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NO_x mg/m³ at Emission Point A3 For the month of October 2024

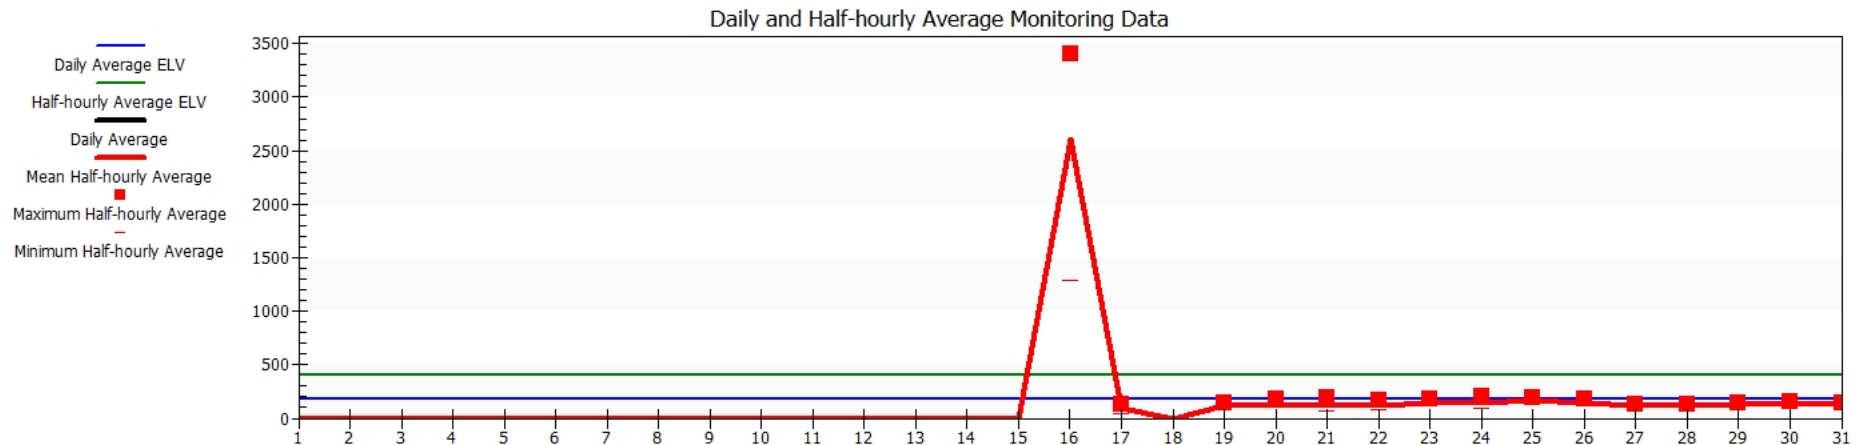

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	3402	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	3402	129	Off	138	176	187	164	175	203	195	179	135	134	142	150	139
	Monthly mean	295	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	2609	96	Off	121	128	119	122	145	147	170	142	124	124	125	126	125
	Monthly minimum	50	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	1287	50	Off	105	100	62	84	116	99	147	115	112	116	116	99	114
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	10	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	10	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	2609	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	2609	96	Off	121	128	119	122	145	147	170	142	124	124	125	126	125
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NO_x mg/m³ at Emission Point A3 For the month of November 2024

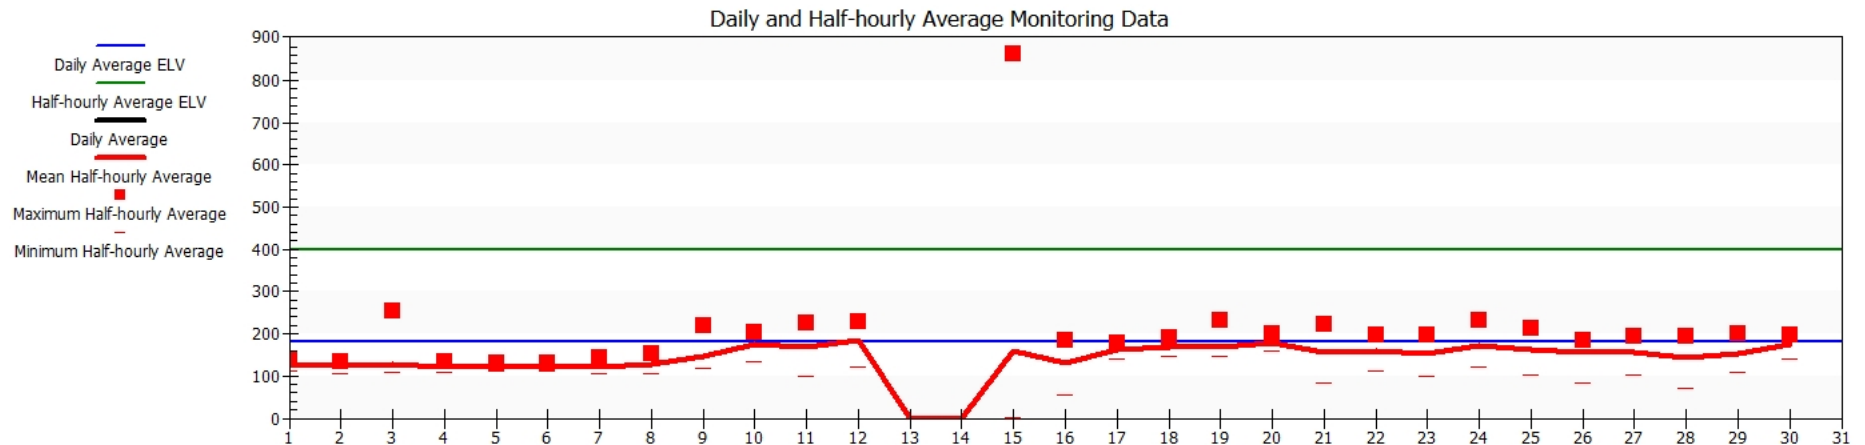

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	862	Maximum Half-hourly average	138	134	254	134	132	131	144	151	220	202	226	228	Off	Off	862	184	179	191	231	200	224	197	198	233	213	184	194	195	199	196	
	Monthly mean	150	Mean Half-hourly average	124	123	127	123	122	121	123	126	147	175	168	184	Off	Off	159	130	163	168	170	177	157	160	152	171	163	156	155	142	152	174	
	Monthly minimum	2	Minimum Half-hourly average	112	105	108	109	111	111	107	107	118	134	98	122	Off	Off	2	55	141	147	146	158	84	112	100	122	101	84	103	70	110	141	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	1	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	
	Monthly maximum	184	Daily average	124	123	127	123	122	121	123	126	147	175	168	184	Off	Off	159	130	163	168	170	177	157	160	152	171	163	156	155	142	152	174	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NO_x mg/m³ at Emission Point A3 For the month of December 2024

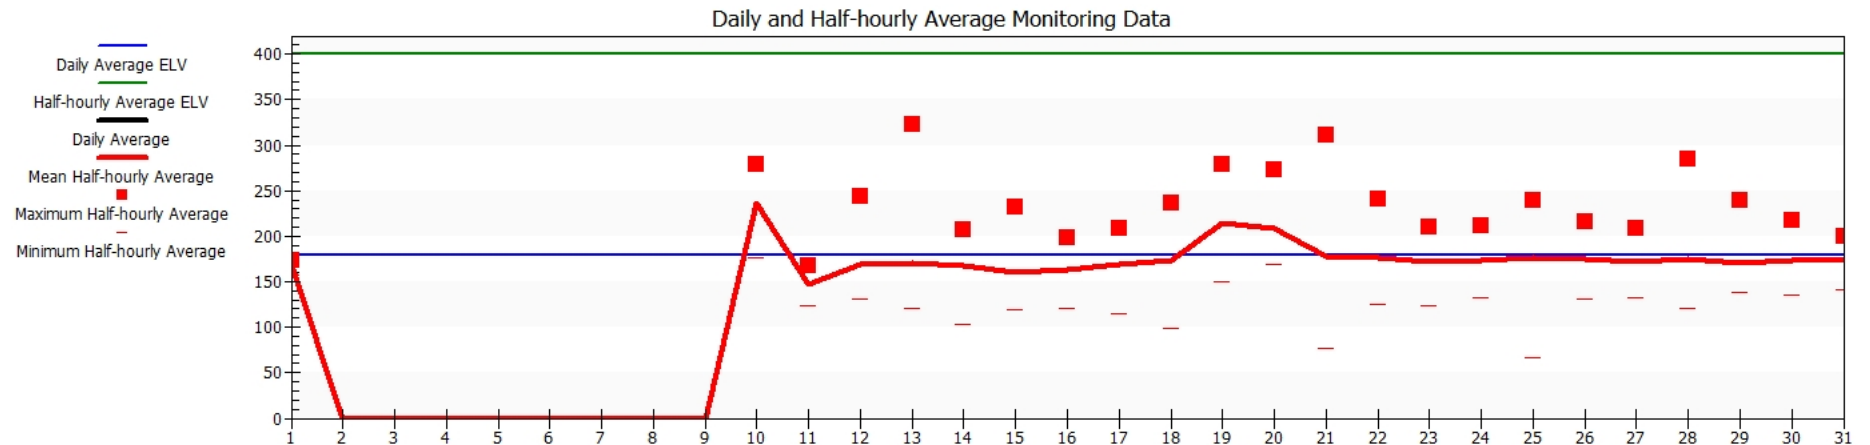

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	
	Monthly maximum	323	Maximum Half-hourly average	173	Off	Off	Off	Off	Off	Off	Off	Off	Off	279	167	244	323	207	232	199	208	236	278	272	312	240	210	211	239	216	208	285	239	217	200
	Monthly mean	176	Mean Half-hourly average	167	Off	Off	Off	Off	Off	Off	Off	Off	Off	236	146	169	170	167	160	163	169	173	214	209	178	176	171	174	176	174	173	175	170	174	173
	Monthly minimum	67	Minimum Half-hourly average	158	Off	Off	Off	Off	Off	Off	Off	Off	Off	176	124	131	121	103	119	120	115	99	150	169	77	126	124	132	67	131	132	121	138	136	141
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	
	Monthly maximum	236	Daily average	167	Off	Off	Off	Off	Off	Off	Off	Off	Off	236	146	169	170	167	160	163	169	173	214	209	178	176	171	174	176	174	173	175	170	174	173
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	3	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	Y	Y	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A3 For the month of October 2024

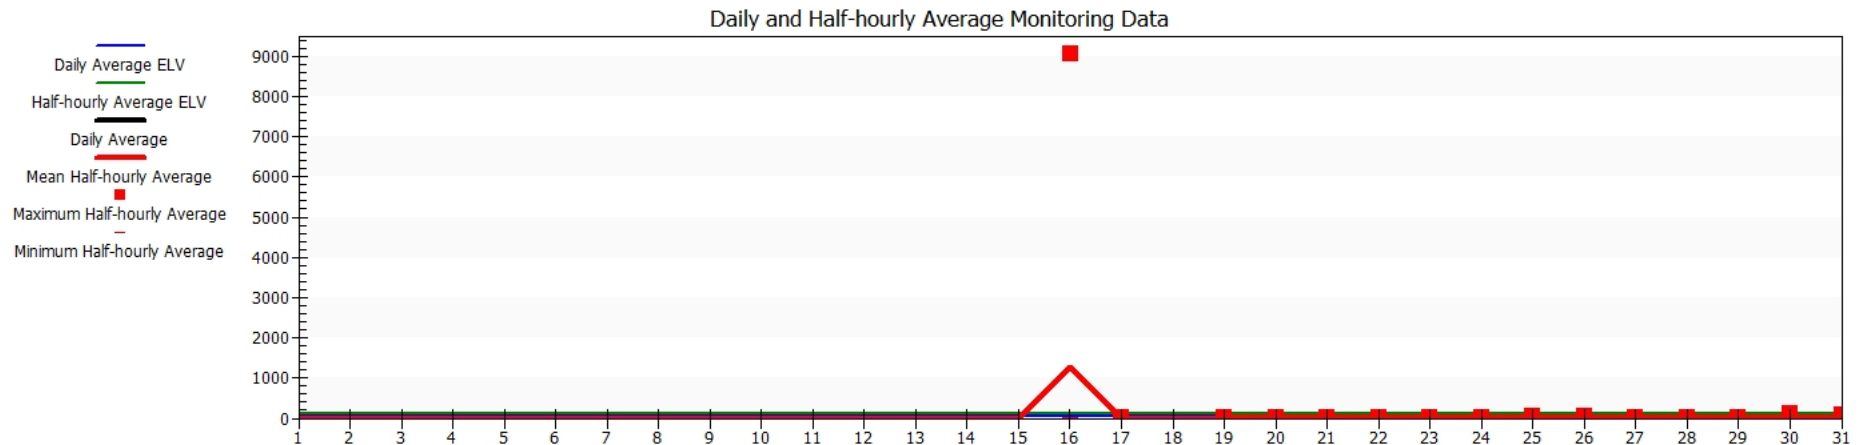

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Monthly maximum	9051	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	9051	12	Off	10	7	12	16	7	31	33	35	23	15	7	107	67
	Monthly mean	88	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	1276	4	Off	5	2	2	3	3	3	4	3	3	3	3	6	6
	Monthly minimum	0	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	24	2	Off	2	0	0	1	1	0	1	0	1	1	1	2	2
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	5	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	4	0	Off	0	0	0	0	0	0	0	0	0	0	0	1
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	1276	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	1276	4	Off	5	2	2	3	3	3	4	3	3	3	3	6	6
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A3 For the month of November 2024

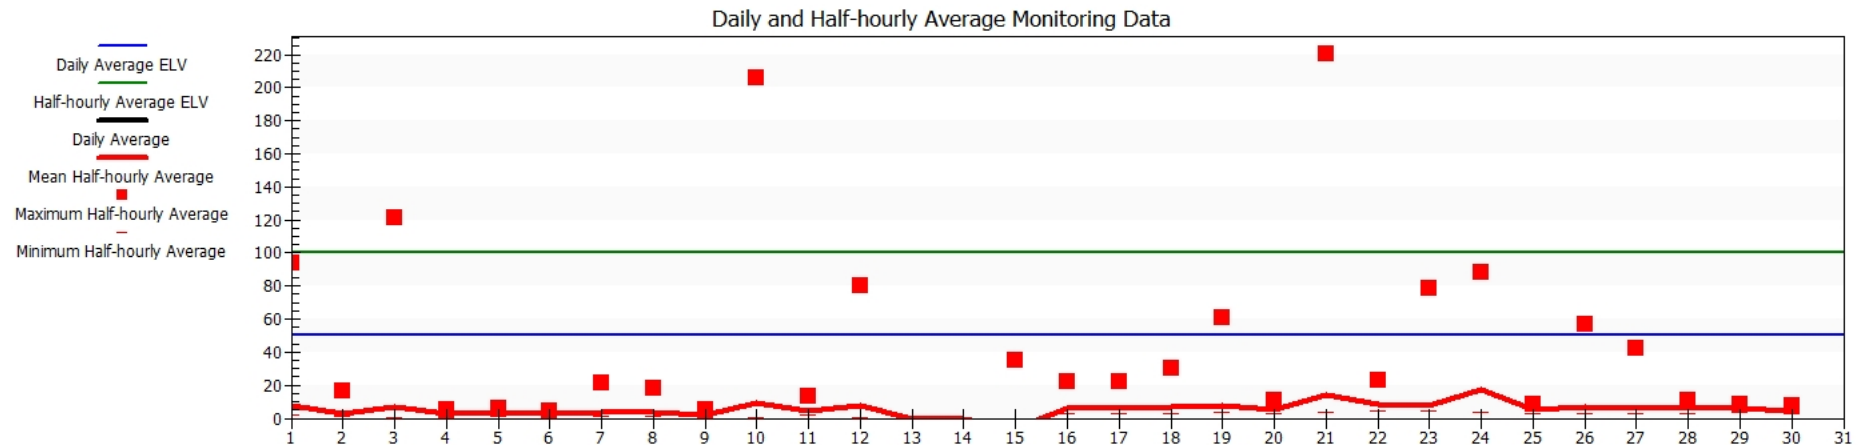

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Monthly maximum	220	Maximum Half-hourly average	94	16	121	5	6	4	21	18	5	206	13	80	Off	Off	35	22	22	30	61	11	220	23	79	88	9	56	42	11	8	8	
	Monthly mean	6	Mean Half-hourly average	8	3	7	2	3	3	3	3	2	9	5	8	Off	Off	0	6	6	7	8	5	14	8	8	18	5	7	6	6	6	4	
	Monthly minimum	0	Minimum Half-hourly average	2	1	1	1	1	1	1	1	0	0	2	1	Off	Off	0	2	3	3	3	3	4	5	4	4	2	3	3	3	4	3	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	3	No of exceedances of ELV	0	0	1	0	0	0	0	0	0	1	0	0	Off	Off	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
	Monthly maximum	18	Daily average	8	3	7	2	3	3	3	3	2	9	5	8	Off	Off	0	6	6	7	8	5	14	8	8	18	5	7	6	6	6	4	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A3 For the month of December 2024

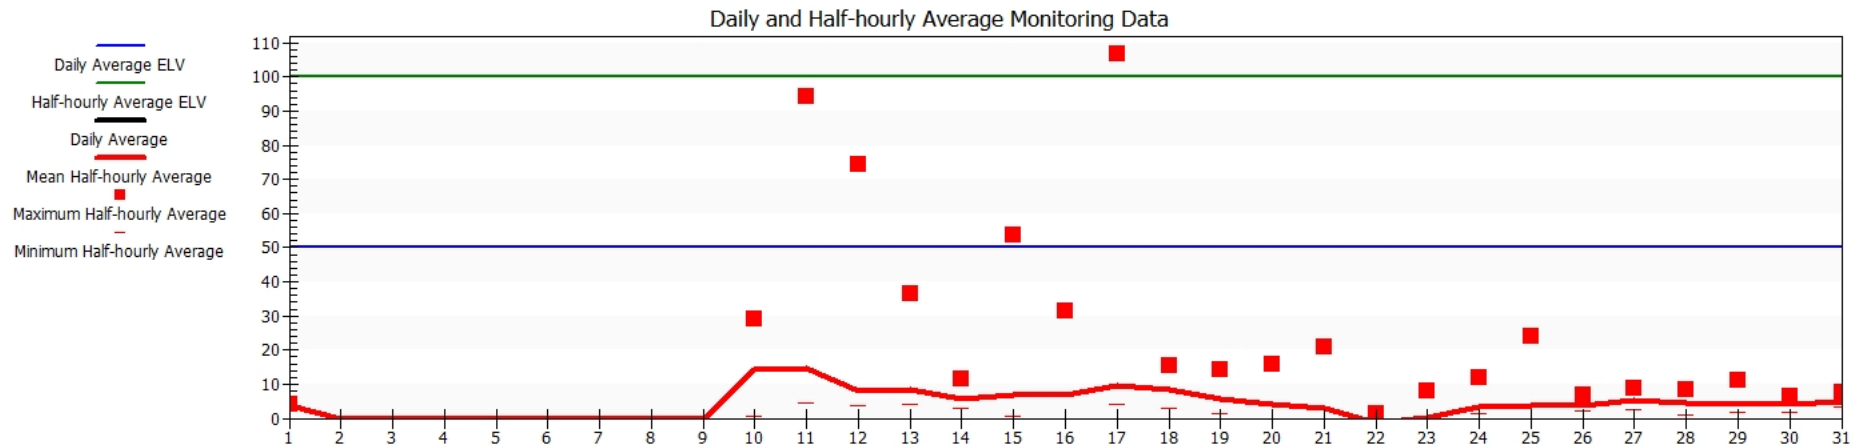

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Monthly maximum	107	Maximum Half-hourly average	4	Off	Off	Off	Off	Off	Off	Off	Off	Off	29	94	74	36	12	54	32	107	15	14	16	21	1	8	12	24	7	9	9	11	6	8
	Monthly mean	6	Mean Half-hourly average	4	Off	Off	Off	Off	Off	Off	Off	Off	Off	14	15	8	8	6	7	7	9	8	6	4	3	0	0	3	4	4	5	5	4	4	5
	Monthly minimum	0	Minimum Half-hourly average	3	Off	Off	Off	Off	Off	Off	Off	Off	Off	1	4	4	4	3	1	0	4	3	1	0	0	0	0	1	0	2	3	1	2	2	3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	1	No of exceedances of ELV	0	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
	Monthly maximum	15	Daily average	4	Off	Off	Off	Off	Off	Off	Off	Off	Off	14	15	8	8	6	7	7	9	8	6	4	3	0	0	3	4	4	5	5	4	4	5
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A3 For the month of October 2024

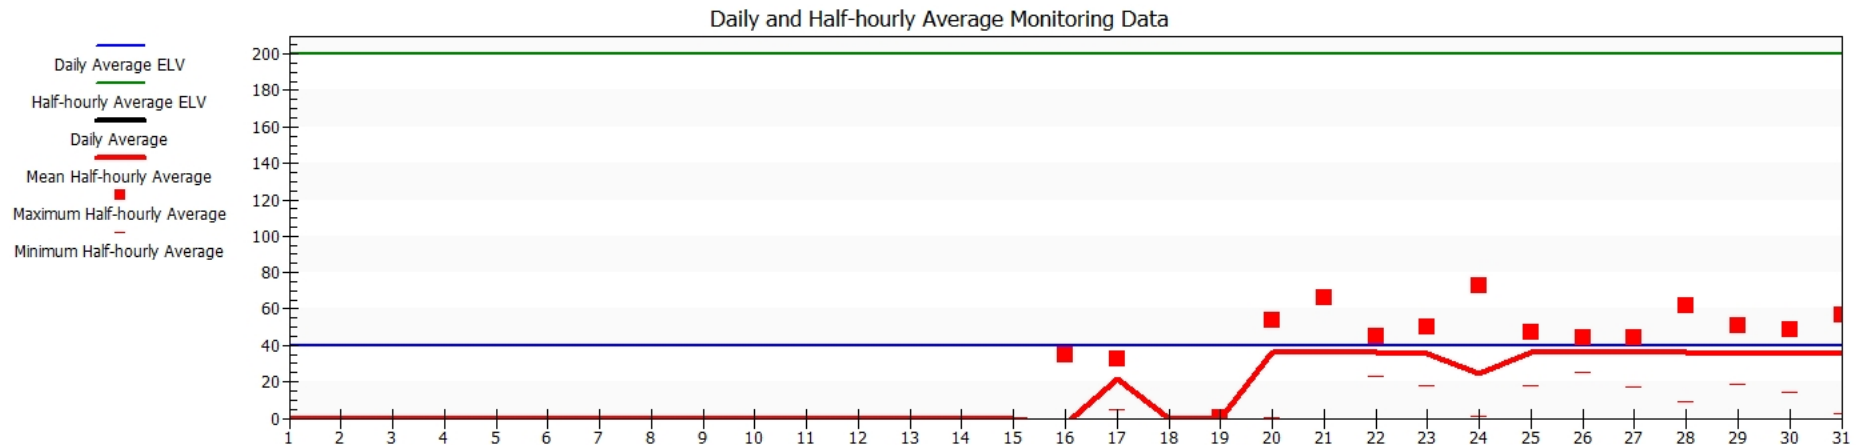

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	73	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	35	32	Off	0	54	66	45	50	73	47	44	44	62	51	48	57
	Monthly mean	29	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	21	Off	0	36	36	36	35	24	36	36	36	36	36	35	36
	Monthly minimum	0	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	5	Off	0	0	0	23	18	1	18	25	17	9	18	15	3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	36	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	21	Off	0	36	36	36	35	24	36	36	36	36	36	35	36
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A3 For the month of November 2024

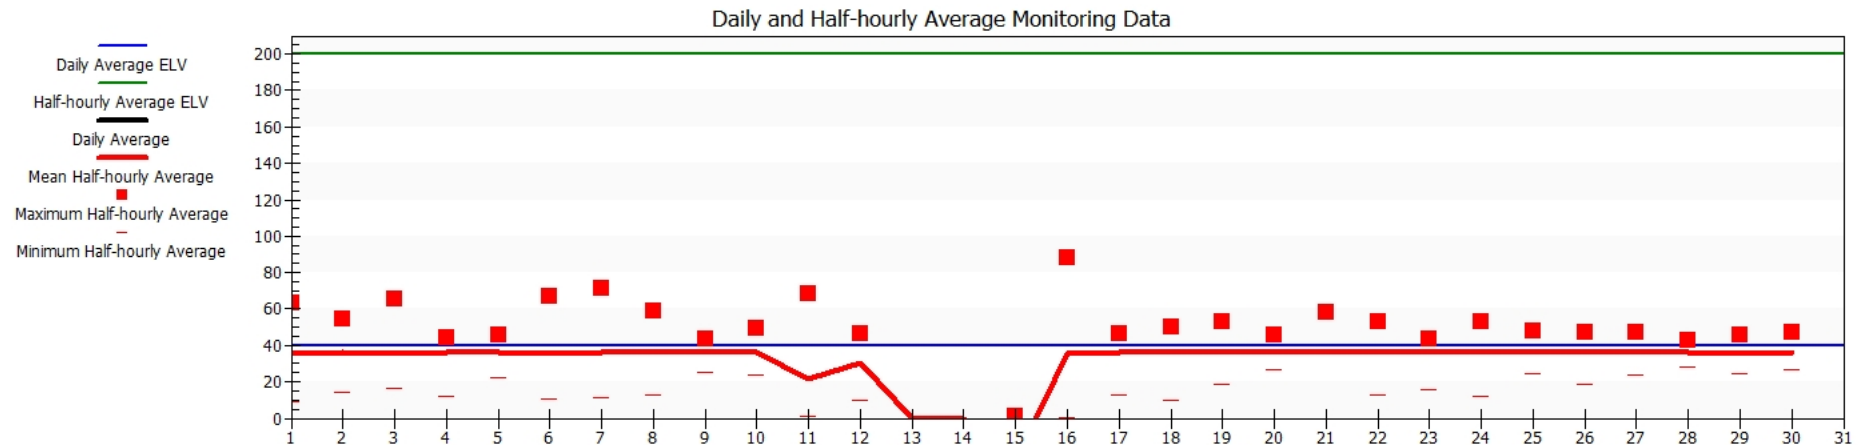

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	88	Maximum Half-hourly average	64	54	65	44	46	67	71	59	43	50	69	47	Off	Off	1	88	46	50	53	46	58	53	44	53	48	47	47	43	45	47		
	Monthly mean	33	Mean Half-hourly average	36	36	36	36	36	35	36	36	36	36	21	31	Off	Off	0	35	36	36	36	36	36	36	36	36	36	36	36	36	36	36	36	
	Monthly minimum	0	Minimum Half-hourly average	9	15	16	12	22	10	11	13	25	23	1	10	Off	Off	0	1	13	10	19	26	0	13	16	12	25	19	24	28	24	27		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	
	Monthly maximum	36	Daily average	36	36	36	36	36	35	36	36	36	36	21	31	Off	Off	0	35	36	36	36	36	36	36	36	36	36	36	36	36	36	36	36	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A3 For the month of December 2024

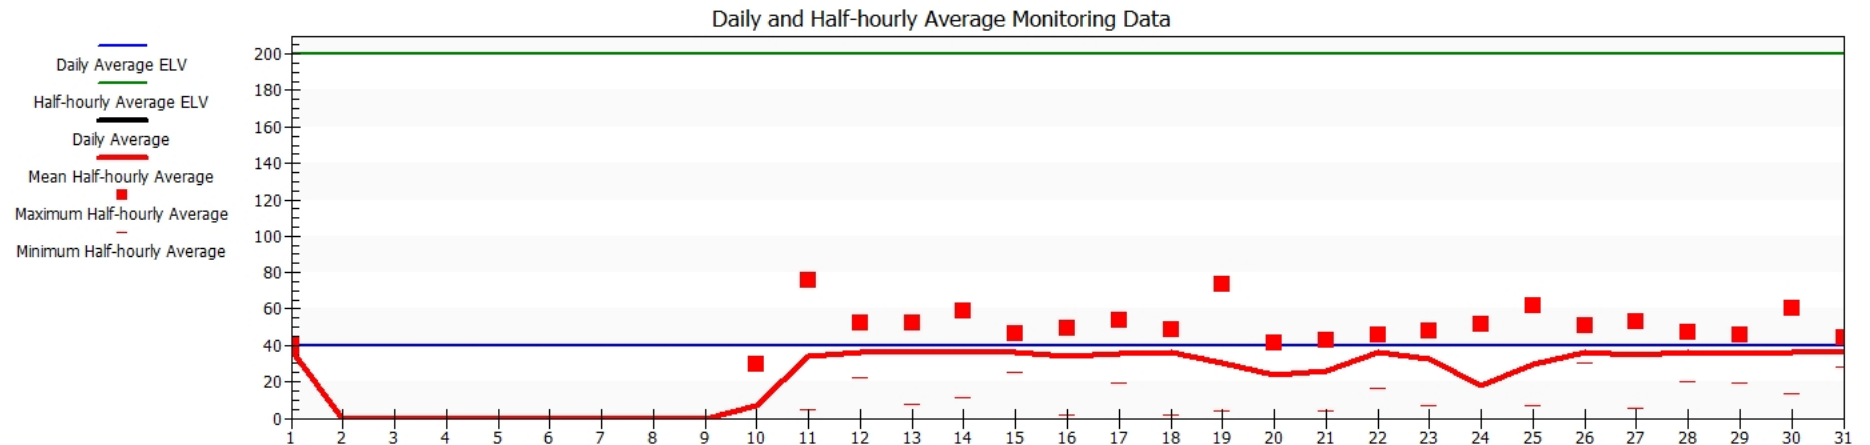

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	
	Monthly maximum	75	Maximum Half-hourly average	40	Off	Off	Off	Off	Off	Off	Off	Off	Off	30	75	52	52	59	47	50	53	49	74	42	43	45	48	52	62	51	53	47	46	60	44
	Monthly mean	32	Mean Half-hourly average	37	Off	Off	Off	Off	Off	Off	Off	Off	Off	7	34	36	36	36	36	34	36	36	31	24	26	36	32	18	30	36	35	36	36	36	
	Monthly minimum	0	Minimum Half-hourly average	35	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	4	22	8	11	25	1	20	2	4	0	4	17	7	0	7	31	5	20	19	13	29
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	
	Monthly maximum	37	Daily average	37	Off	Off	Off	Off	Off	Off	Off	Off	Off	7	34	36	36	36	36	34	36	36	31	24	26	36	32	18	30	36	35	36	36	36	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A3 For the month of October 2024

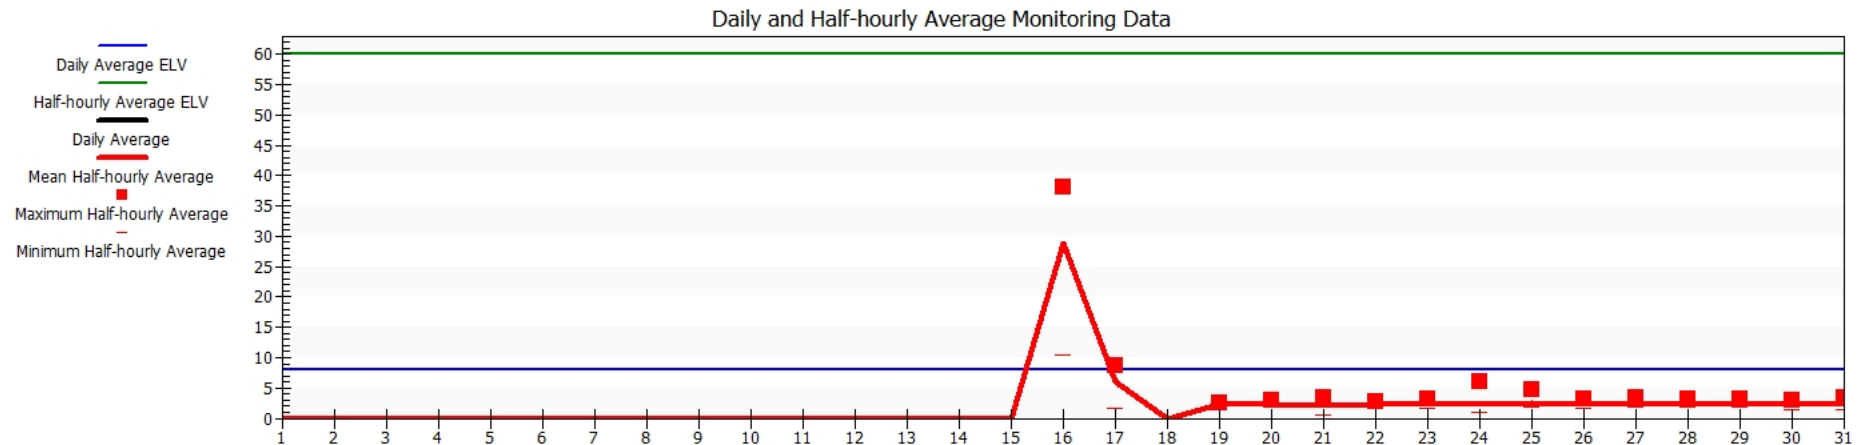

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	38	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	38	9	Off	3	3	3	3	3	6	5	3	3	3	3	3	3
	Monthly mean	4	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	29	6	Off	2	2	2	2	2	2	3	2	2	2	2	3	2
	Monthly minimum	1	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	10	2	Off	2	2	1	2	2	1	2	2	2	2	2	2	2
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
	Monthly maximum	29	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	29	6	Off	2	2	2	2	2	2	3	2	2	2	2	3	2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A3 For the month of November 2024

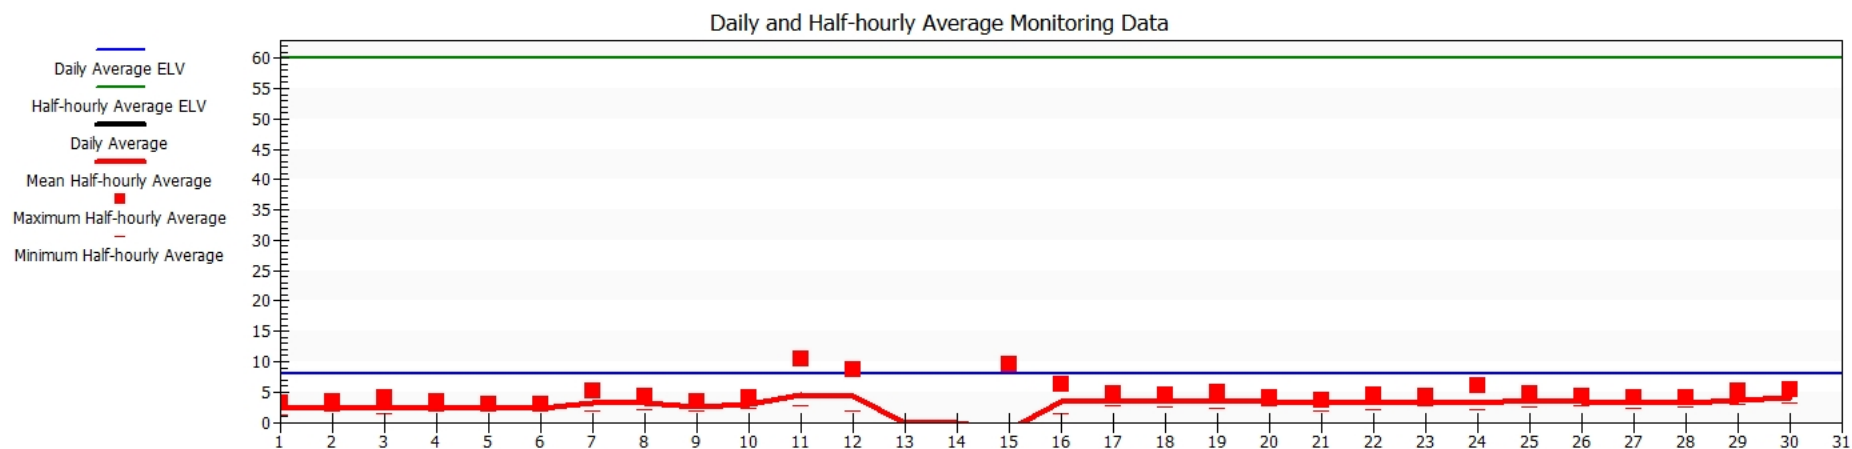

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	11	Maximum Half-hourly average	3	3	4	3	3	3	5	4	3	4	11	9	Off	Off	9	6	5	5	5	4	4	5	4	6	5	4	4	4	5	5	
	Monthly mean	3	Mean Half-hourly average	2	2	2	3	2	2	3	3	3	3	5	4	Off	Off	0	3	4	3	3	3	3	3	3	3	4	3	3	3	4	4	
	Monthly minimum	0	Minimum Half-hourly average	1	2	1	2	2	2	2	2	2	2	3	2	Off	Off	0	1	3	2	2	3	2	2	3	2	3	3	2	3	3	3	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	
	Monthly maximum	5	Daily average	2	2	2	3	2	2	3	3	3	3	5	4	Off	Off	0	3	4	3	3	3	3	3	3	3	4	3	3	3	4	4	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A3 For the month of December 2024

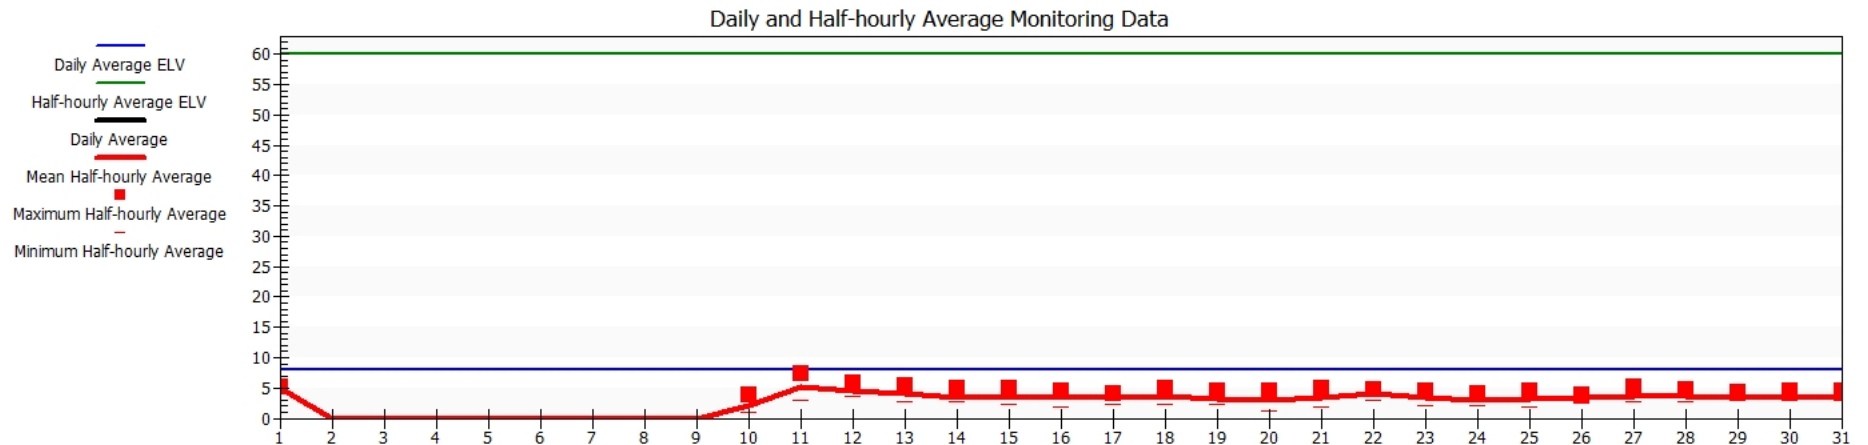

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	
	Monthly maximum	7	Maximum Half-hourly average	5	Off	Off	Off	Off	Off	Off	Off	Off	Off	4	7	6	5	5	5	4	4	5	5	4	5	5	4	4	4	4	5	5	4	4	4
	Monthly mean	4	Mean Half-hourly average	5	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	5	4	4	4	4	3	3	4	3	3	3	4	3	3	3	3	4	4	4	4	3
	Monthly minimum	1	Minimum Half-hourly average	5	Off	Off	Off	Off	Off	Off	Off	Off	Off	1	3	4	3	3	2	2	2	2	2	1	2	3	2	2	2	3	3	3	3	3	3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	
	Monthly maximum	5	Daily average	5	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	5	4	4	4	4	3	3	4	3	3	3	4	3	3	3	3	4	4	4	4	3
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A3 For the month of October 2024

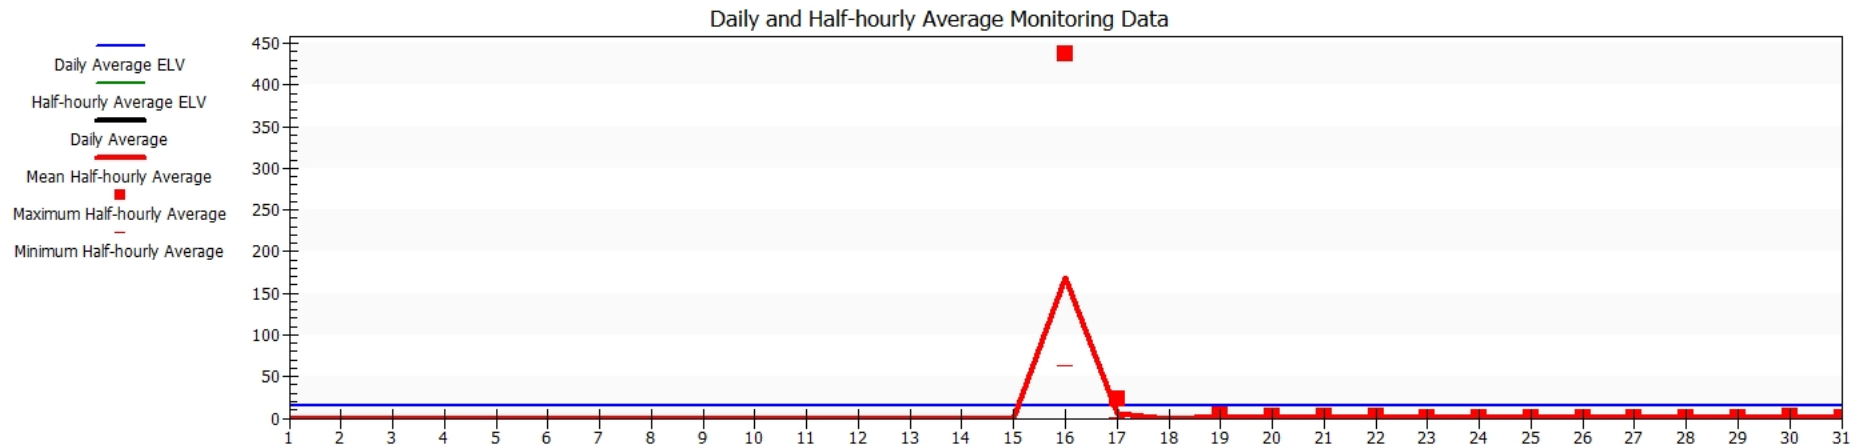

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	437	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	437	24	Off	3	3	2	2	1	1	1	1	1	1	1	3	1	
	Monthly mean	12	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	169	5	Off	3	1	1	1	1	1	1	1	1	1	1	1	1	
	Monthly minimum	1	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	63	1	Off	2	1	1	1	1	1	1	1	1	1	1	1	1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	N/A	N/A	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	
	Monthly maximum	169	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	169	5	Off	3	1	1	1	1	1	1	1	1	1	1	1	1	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A3 For the month of November 2024

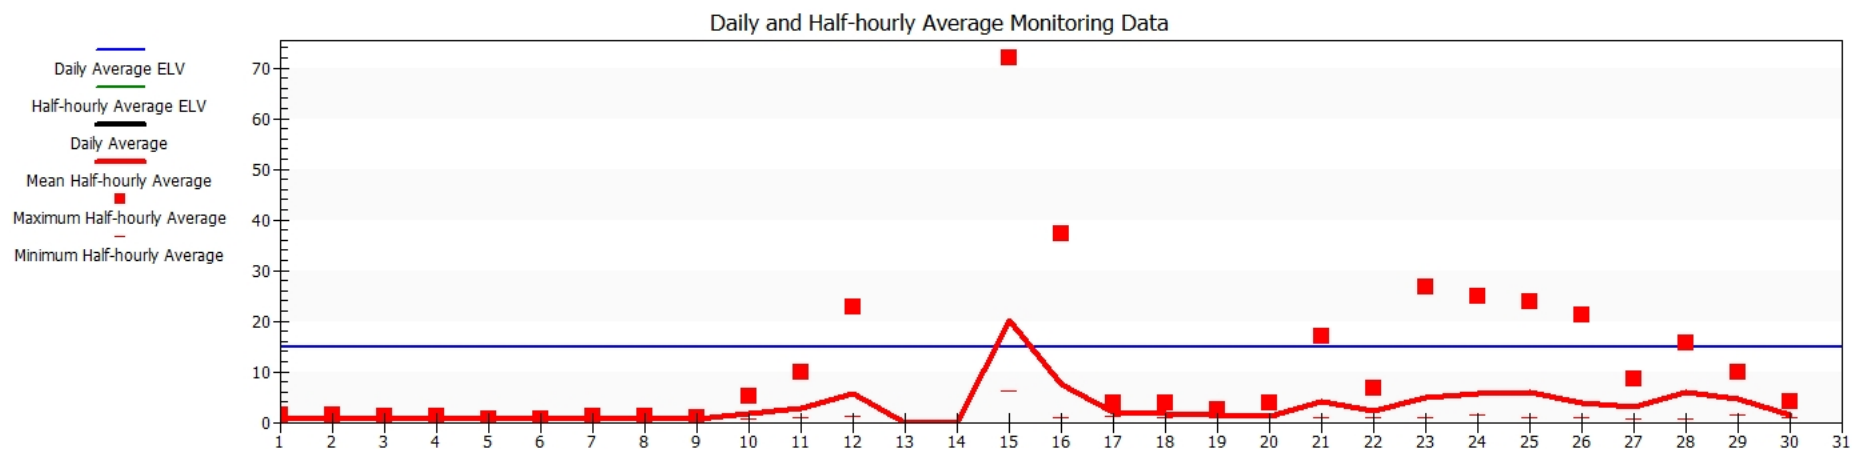

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	72	Maximum Half-hourly average	2	1	1	1	1	1	1	1	1	5	10	23	Off	Off	72	37	4	4	2	4	17	7	27	25	24	21	9	16	10	4	
	Monthly mean	3	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	2	3	6	Off	Off	20	8	2	2	2	1	4	2	5	6	6	4	3	6	4	1	
	Monthly minimum	0	Minimum Half-hourly average	1	1	0	0	0	1	0	1	0	1	1	1	Off	Off	6	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	
	Monthly maximum	20	Daily average	1	1	1	1	1	1	1	1	1	2	3	6	Off	Off	20	8	2	2	2	1	4	2	5	6	6	4	3	6	4	1	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A3 For the month of December 2024

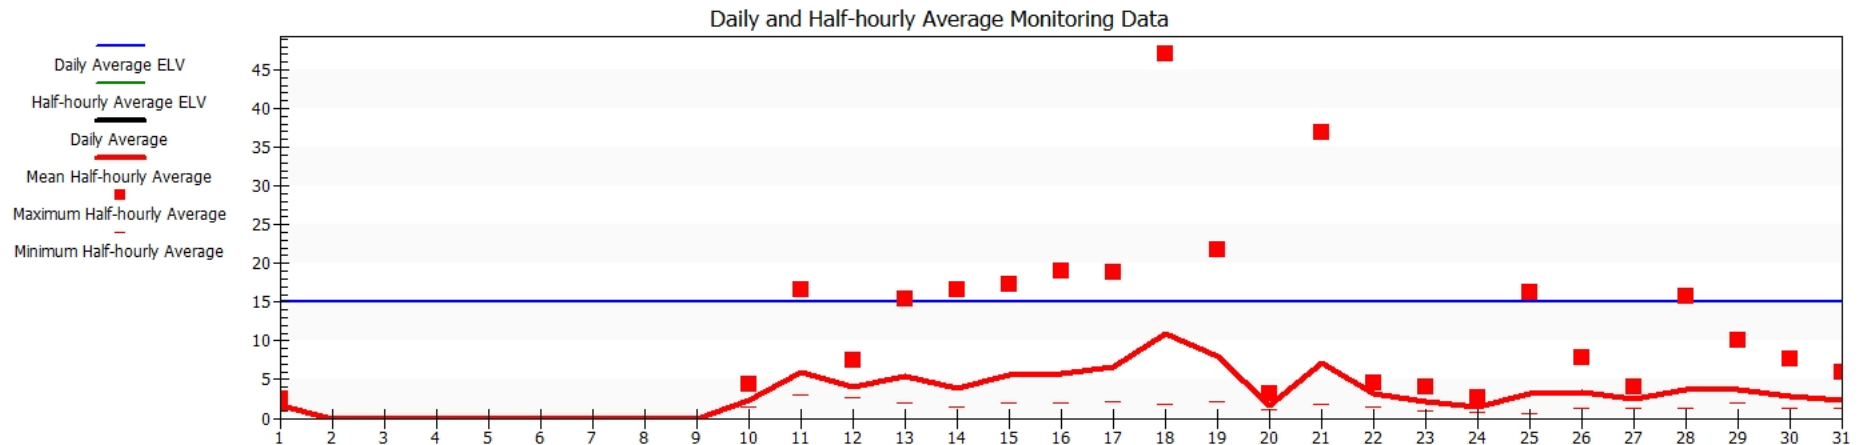

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	47	Maximum Half-hourly average	3	Off	Off	Off	Off	Off	Off	Off	Off	Off	4	17	7	15	17	17	19	19	47	22	3	37	5	4	3	16	8	4	16	10	8	6
	Monthly mean	4	Mean Half-hourly average	2	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	6	4	5	4	6	6	7	11	8	2	7	3	2	1	3	3	2	4	4	3	2
	Monthly minimum	1	Minimum Half-hourly average	1	Off	Off	Off	Off	Off	Off	Off	Off	Off	1	3	3	2	1	2	2	2	2	2	1	2	1	1	1	1	1	1	1	2	1	1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	Off	Off	Off	Off	Off	Off	Off	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15
	Monthly maximum	11	Daily average	2	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	6	4	5	4	6	6	7	11	8	2	7	3	2	1	3	3	2	4	4	3	2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A3 For the month of October 2024

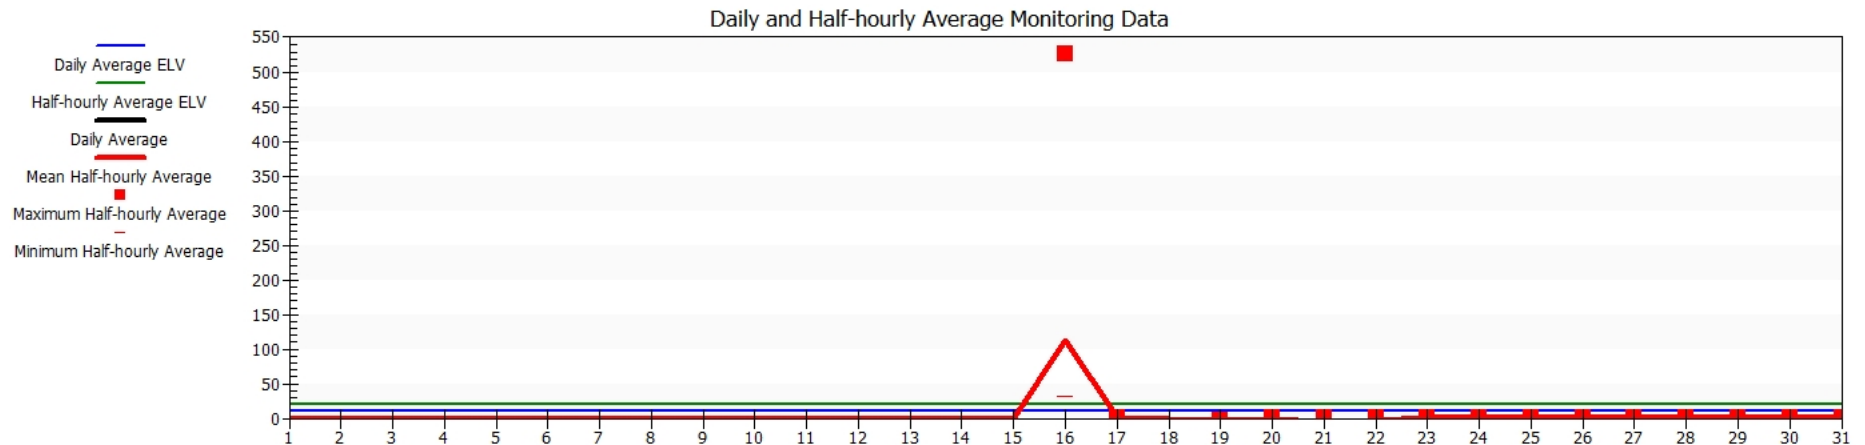

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	
	Monthly maximum	527	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	527	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly mean	7	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	112	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	32	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	10	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	10	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
	Monthly maximum	112	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	112	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A3 For the month of November 2024

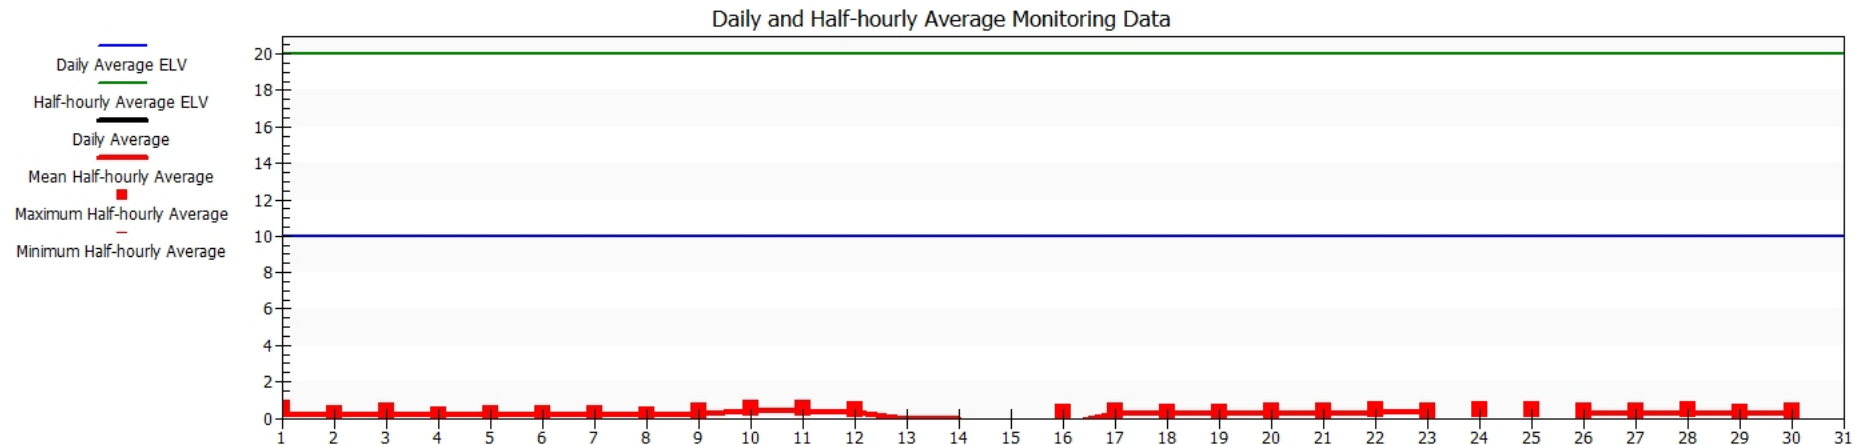

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	31	
	Monthly maximum	1	Maximum Half-hourly average	1	0	0	0	0	0	0	0	0	1	1	0	Off	Off	0	0	0	0	0	0	0	1	0	1	0	0	0	0	0	0	0		
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	0	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	0

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A3 For the month of December 2024

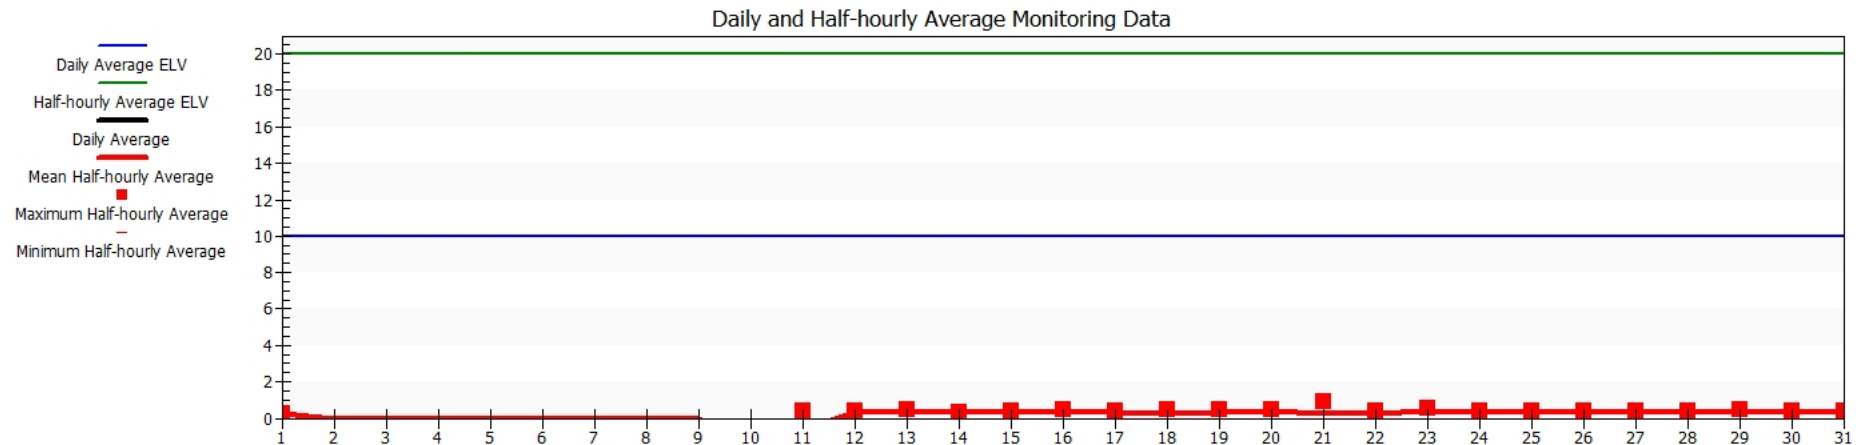

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
	Monthly maximum	1	Maximum Half-hourly average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	1	0	1	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	0	Daily average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A3 For the month of October 2024

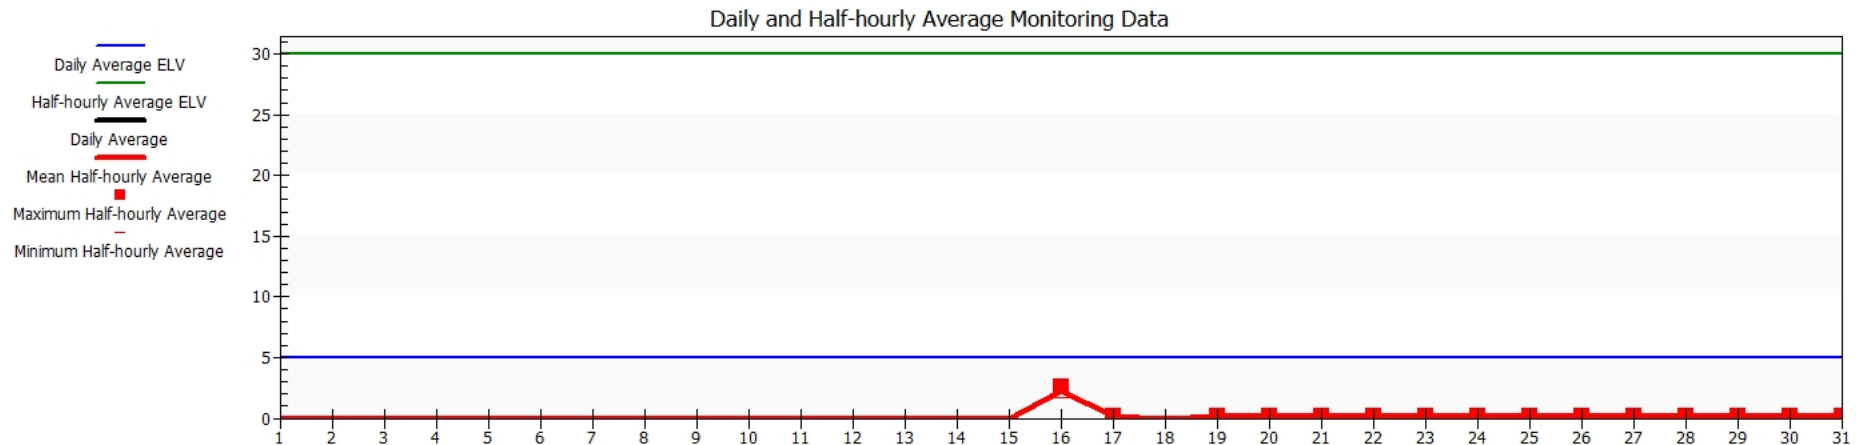

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	3	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	3	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	Monthly maximum	2	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	2	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allertop Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A3 For the month of November 2024

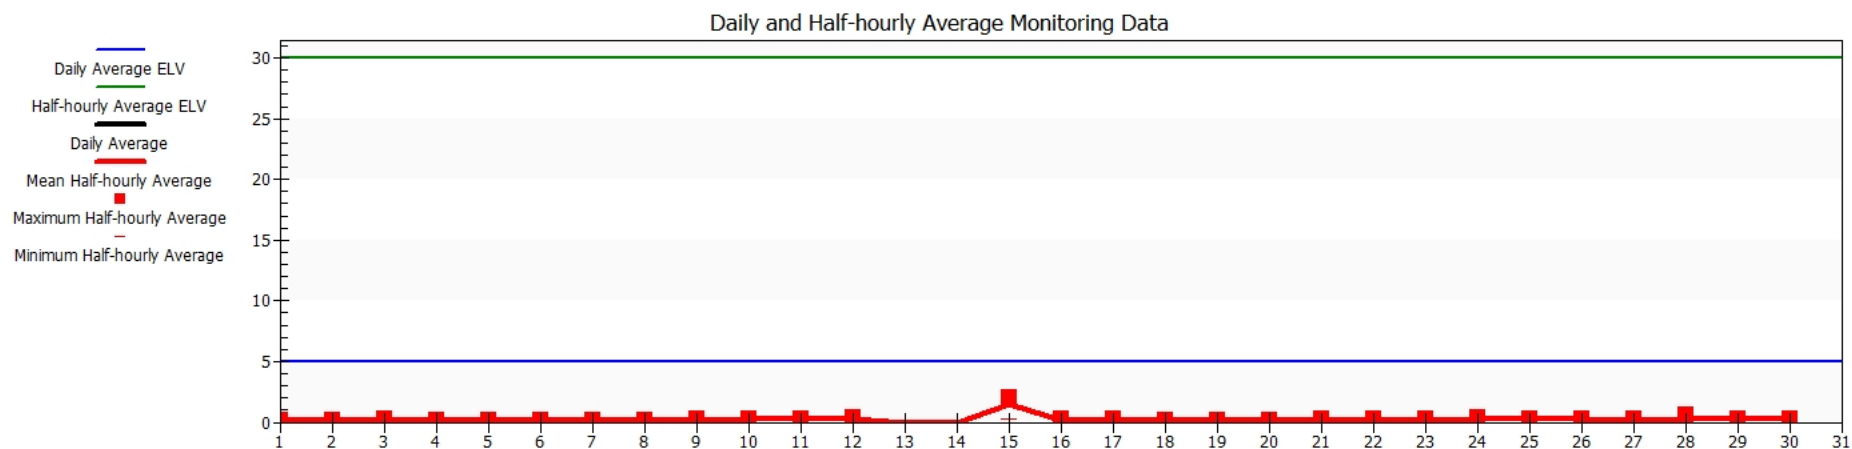

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	2	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	2	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	Monthly maximum	2	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A3 For the month of December 2024

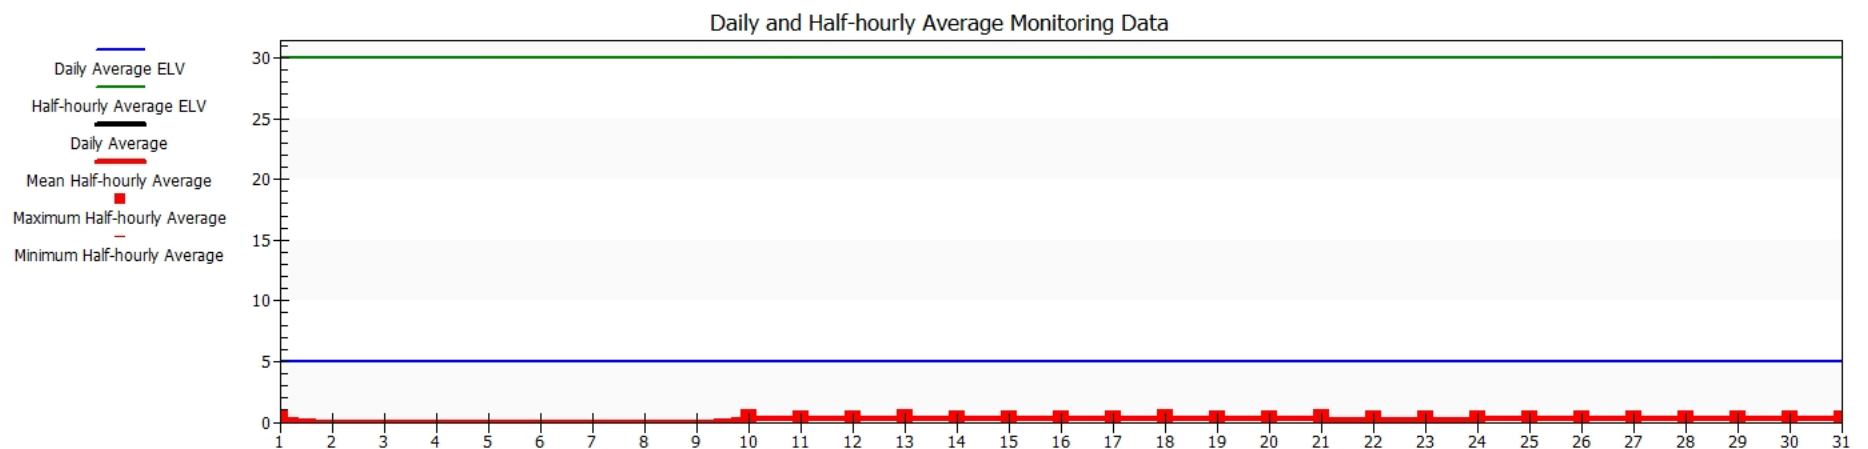

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	0	Maximum Half-hourly average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	Monthly maximum	0	Daily average	0	Off	Off	Off	Off	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for N2O mg/m3 at Emission Point A3 For the month of October 2024

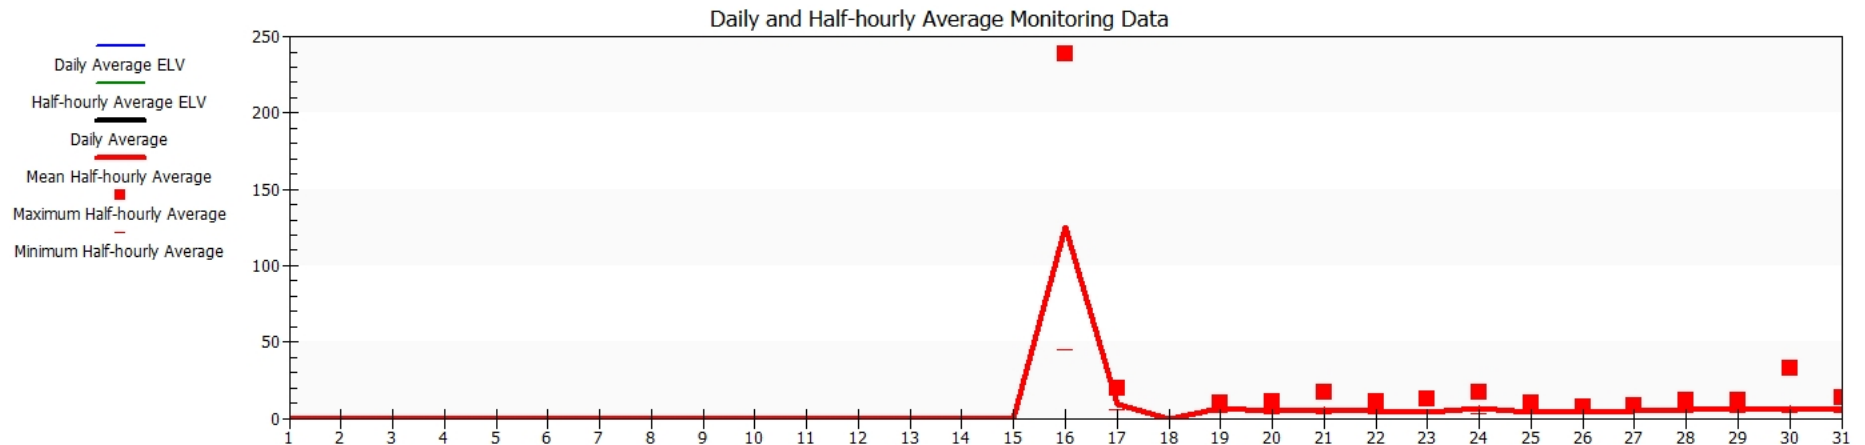

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	239	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	239	20	Off	10	11	17	11	12	17	10	8	8	12	12	33	14
	Monthly mean	14	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	126	9	Off	6	5	6	5	4	7	4	4	5	6	5	7	6
	Monthly minimum	3	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	45	5	Off	4	3	3	3	3	3	3	3	4	4	4	4	4
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	N/A	N/A	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	126	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	126	9	Off	6	5	6	5	4	7	4	4	5	6	5	7	6
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for N2O mg/m3 at Emission Point A3 For the month of November 2024

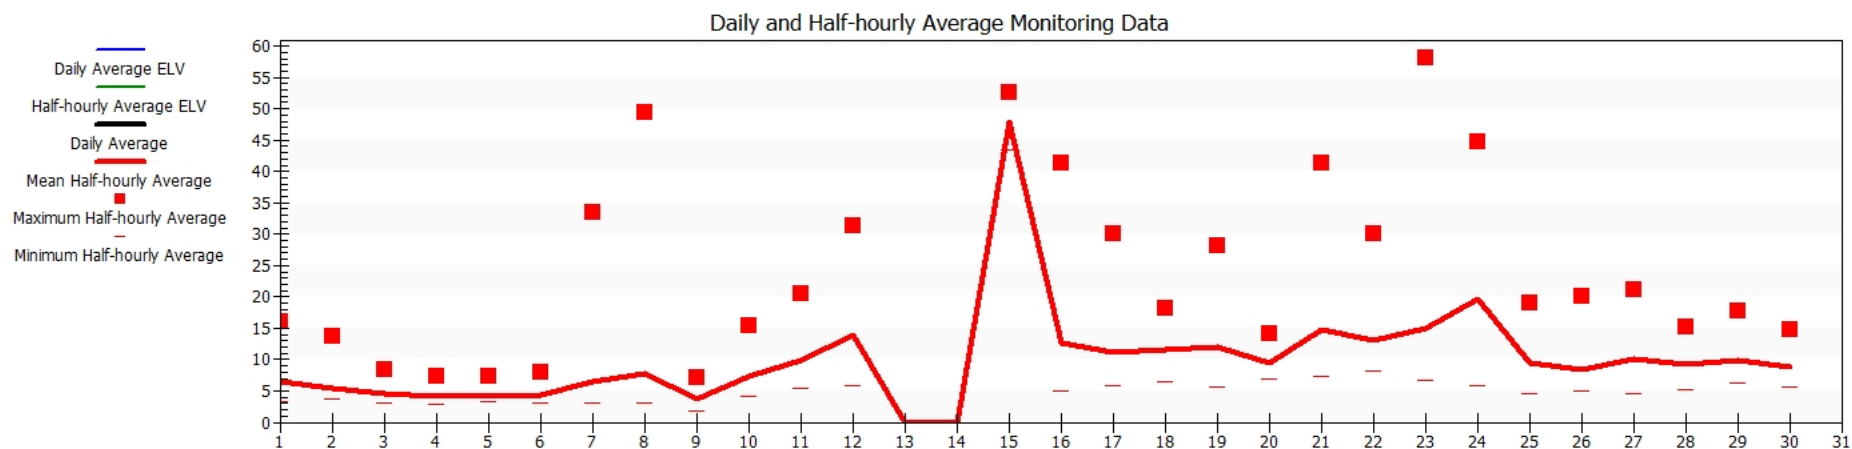

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	58	Maximum Half-hourly average	16	14	8	7	7	8	34	49	7	15	21	31	Off	Off	53	41	30	18	28	14	41	30	58	45	19	20	21	15	18	15	
	Monthly mean	11	Mean Half-hourly average	6	5	5	4	4	4	6	8	4	7	10	14	Off	Off	48	13	11	12	12	9	15	13	15	20	9	8	10	9	10	9	
	Monthly minimum	2	Minimum Half-hourly average	3	4	3	3	3	3	3	3	2	4	5	6	Off	Off	44	5	6	6	6	7	7	8	7	6	5	5	5	5	6	6	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	48	Daily average	6	5	5	4	4	4	6	8	4	7	10	14	Off	Off	48	13	11	12	12	9	15	13	15	20	9	8	10	9	10	9	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for N2O mg/m3 at Emission Point A3 For the month of December 2024

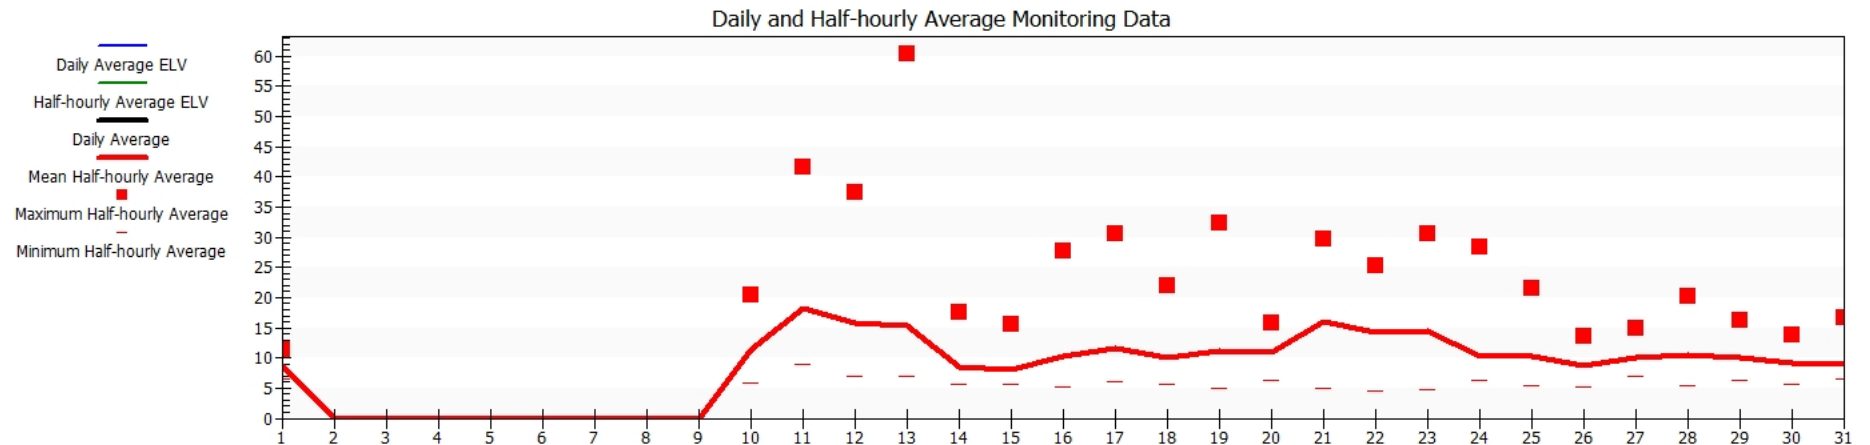

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	60	Maximum Half-hourly average	11	Off	Off	Off	Off	Off	Off	Off	Off	Off	21	42	37	60	18	16	28	31	22	32	16	30	25	31	28	22	14	15	20	16	14	17	
	Monthly mean	11	Mean Half-hourly average	9	Off	Off	Off	Off	Off	Off	Off	Off	Off	11	18	16	15	9	8	10	12	10	11	11	16	14	14	10	10	9	10	10	10	9	9	
	Monthly minimum	4	Minimum Half-hourly average	6	Off	Off	Off	Off	Off	Off	Off	Off	Off	6	9	7	7	6	6	5	6	6	5	6	5	4	5	6	5	5	7	5	6	6	7	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	Off	Off	Off	Off	Off	Off	Off	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	18	Daily average	9	Off	Off	Off	Off	Off	Off	Off	Off	Off	11	18	16	15	9	8	10	12	10	11	11	16	14	14	10	10	9	10	10	10	9	9	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A3 For the month of October 2024

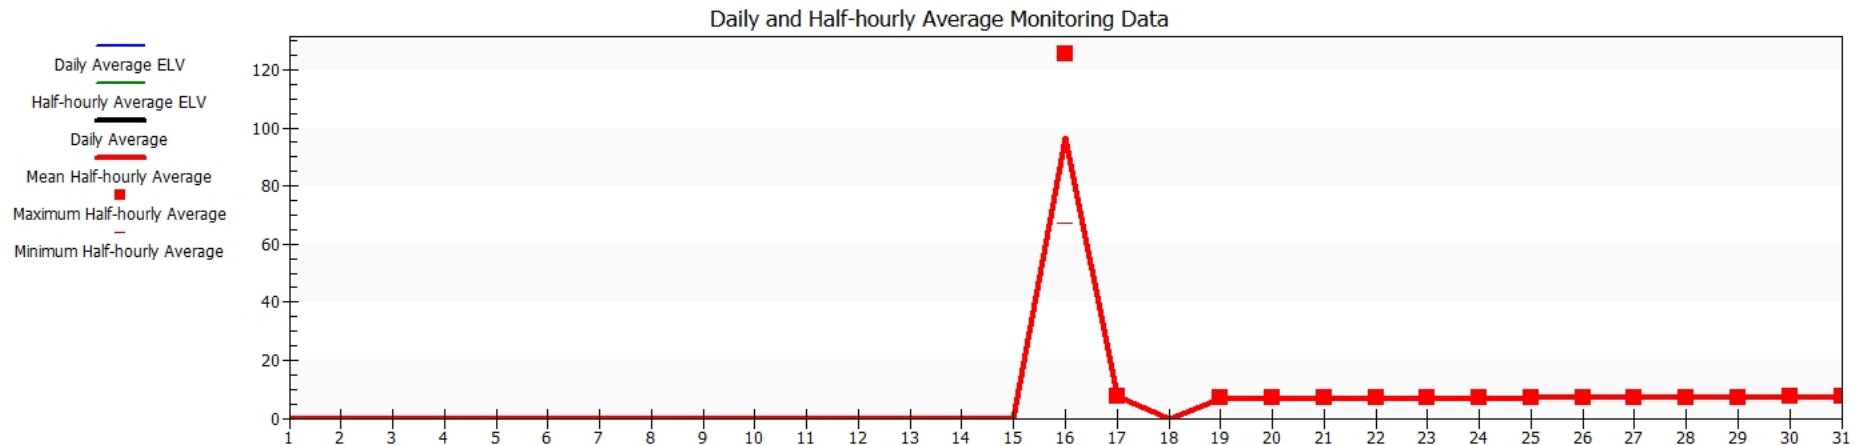

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	125	Maximum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	125	7	Off	7	7	7	7	7	7	7	7	7	7	7	7	7	
	Monthly mean	13	Mean Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	97	7	Off	7	7	7	7	7	7	7	7	7	7	7	7	7	
	Monthly minimum	6	Minimum Half-hourly average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	67	7	Off	6	7	6	7	7	6	7	7	7	7	7	7	7	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	N/A	N/A	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	97	Daily average	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	Off	97	7	Off	7	7	7	7	7	7	7	7	7	7	7	7	7	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A3 For the month of November 2024

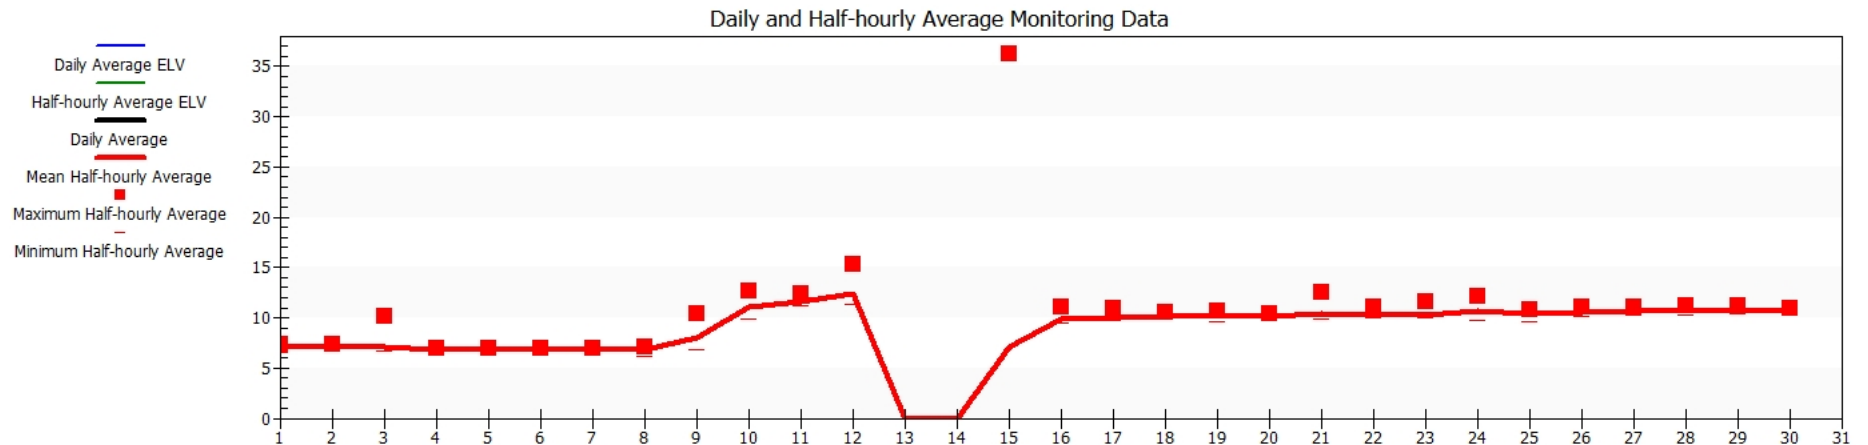

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	36	Maximum Half-hourly average	7	7	10	7	7	7	7	7	10	13	12	15	Off	Off	36	11	11	10	11	10	13	11	12	12	11	11	11	11	11	11		
	Monthly mean	9	Mean Half-hourly average	7	7	7	7	7	7	7	7	8	11	12	12	Off	Off	7	10	10	10	10	10	10	10	10	10	11	10	11	11	11	11		
	Monthly minimum	0	Minimum Half-hourly average	7	7	7	7	7	7	7	6	7	10	11	11	Off	Off	0	9	10	10	10	10	10	10	10	10	10	10	10	10	10	10		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	12	Daily average	7	7	7	7	7	7	7	7	8	11	12	12	Off	Off	7	10	10	10	10	10	10	10	10	10	11	10	11	11	11	11	11	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A3 For the month of December 2024

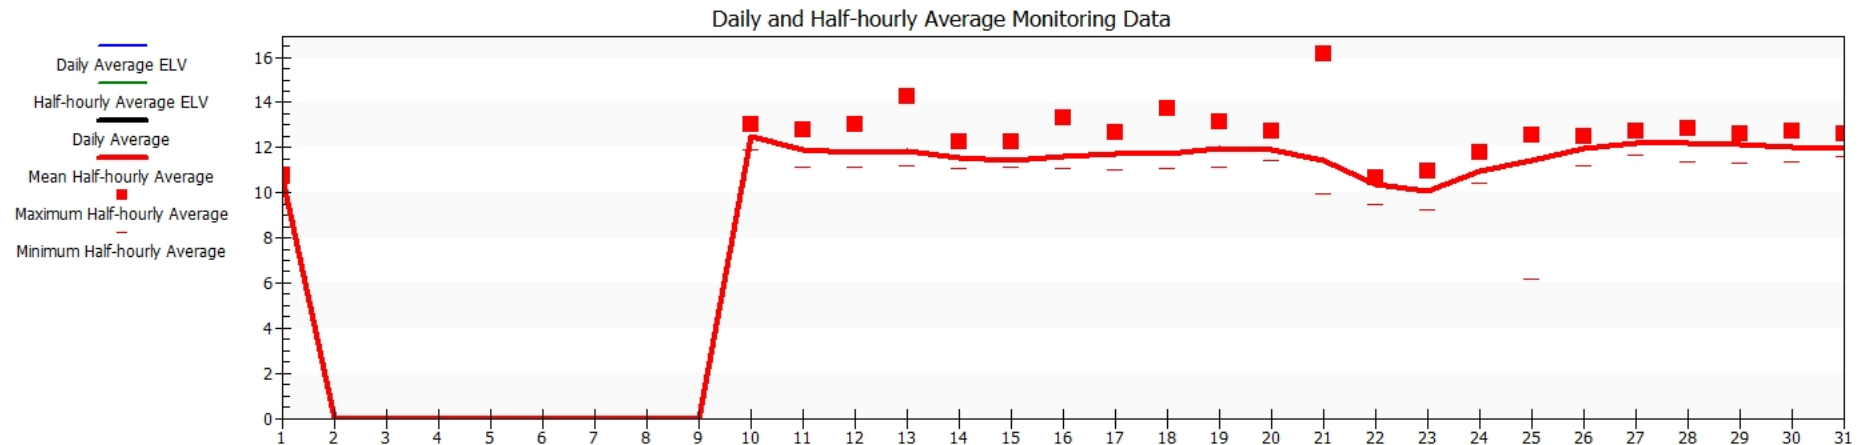

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	16	Maximum Half-hourly average	11	Off	Off	Off	Off	Off	Off	Off	Off	Off	13	13	13	14	12	12	13	13	14	13	13	16	11	11	12	13	13	13	13	13	13	
	Monthly mean	12	Mean Half-hourly average	11	Off	Off	Off	Off	Off	Off	Off	Off	Off	12	12	12	12	12	11	12	12	12	12	12	11	10	10	11	11	12	12	12	12	12	
	Monthly minimum	6	Minimum Half-hourly average	10	Off	Off	Off	Off	Off	Off	Off	Off	Off	12	11	11	11	11	11	11	11	11	11	11	10	9	9	10	6	11	12	11	11	11	12
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	Off	Off	Off	Off	Off	Off	Off	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	12	Daily average	11	Off	Off	Off	Off	Off	Off	Off	Off	Off	12	12	12	12	12	11	12	12	12	12	12	11	10	10	11	11	12	12	12	12	12	12
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)