


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 NOx

Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A2 For the month of January 2026

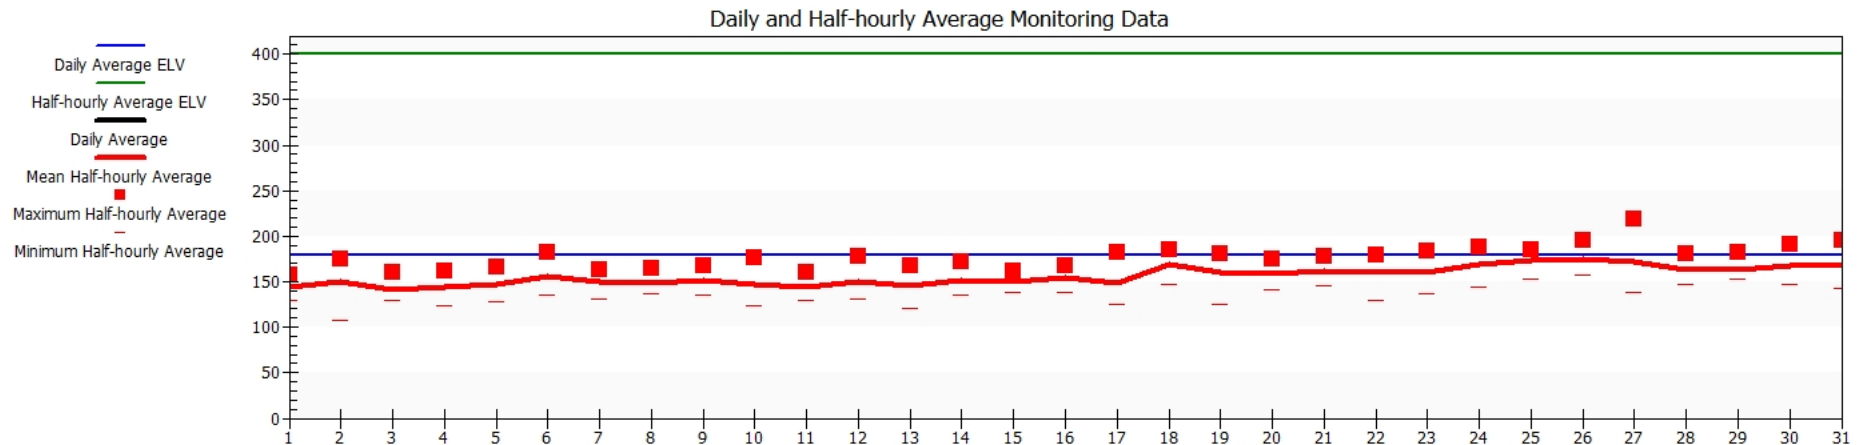

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	219	Maximum Half-hourly average	157	176	160	162	166	183	162	164	168	176	160	178	168	172	162	167	182	185	180	175	178	179	183	188	185	195	219	180	183	192	195
	Monthly mean	156	Mean Half-hourly average	144	150	141	144	147	156	150	149	151	147	144	150	145	152	150	154	149	169	161	159	161	161	161	169	173	175	172	163	164	168	168
	Monthly minimum	108	Minimum Half-hourly average	129	108	129	123	128	135	132	136	136	123	129	131	121	135	138	138	125	147	126	141	145	129	138	144	153	157	139	147	153	147	142
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	175	Daily average	144	150	141	144	147	156	150	149	151	147	144	150	145	152	150	154	149	169	161	159	161	161	161	169	173	175	172	163	164	168	168
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 NOx

Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A2 For the month of February 2026

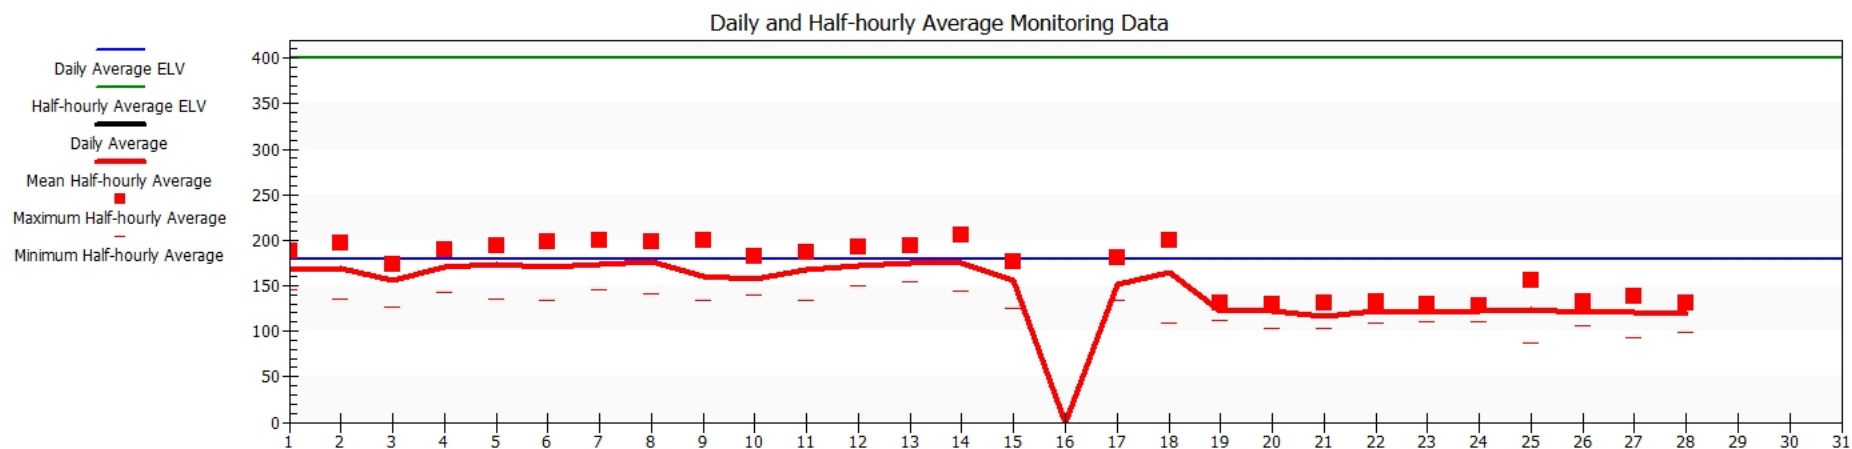

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400				
	Monthly maximum	206	Maximum Half-hourly average	188	197	173	190	194	198	200	199	199	182	186	193	193	206	176	Off	180	200	130	130	131	133	129	128	156	132	138	131				
	Monthly mean	150	Mean Half-hourly average	168	169	155	171	173	170	174	177	161	158	167	172	176	174	157	Off	152	164	122	121	117	123	121	122	124	121	121	120				
	Monthly minimum	87	Minimum Half-hourly average	145	135	126	142	135	134	146	142	134	139	134	150	154	145	126	Off	134	108	112	102	103	109	110	110	87	106	92	98				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180				
	Monthly maximum	177	Daily average	168	169	155	171	173	170	174	177	161	158	167	172	176	174	157	Off	152	164	122	121	117	123	121	122	124	121	121	120				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 NOx

Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A2 For the month of March 2026

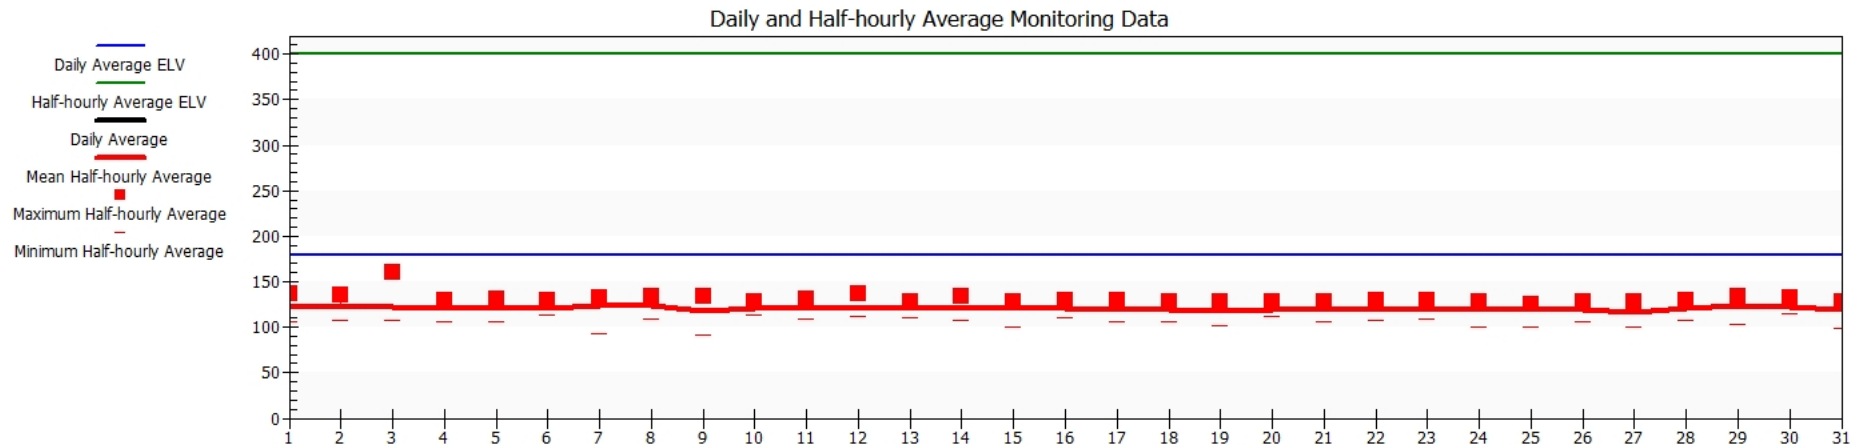

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	160	Maximum Half-hourly average	137	135	160	129	132	129	132	134	134	128	130	137	129	134	129	129	129	129	128	128	128	129	129	128	126	129	129	130	134	132	127
	Monthly mean	121	Mean Half-hourly average	122	123	123	121	121	121	123	123	118	121	121	121	121	121	122	121	120	119	118	119	121	119	119	119	119	120	117	121	123	123	120
	Monthly minimum	92	Minimum Half-hourly average	106	107	108	106	106	113	93	109	92	114	109	112	111	107	100	110	106	106	102	112	106	107	109	100	100	106	100	107	104	114	99
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	123	Daily average	122	123	123	121	121	121	123	123	118	121	121	121	121	121	122	121	120	119	118	119	121	119	119	119	119	120	117	121	123	123	120
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 CO

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A2 For the month of January 2026

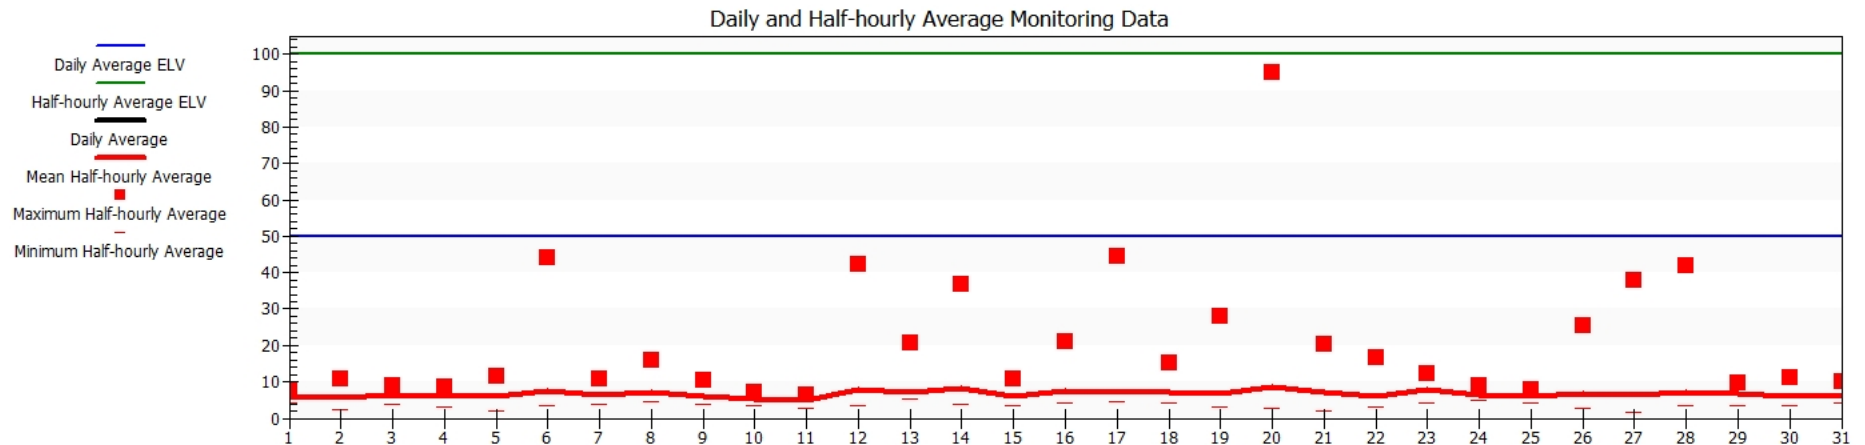

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Monthly maximum	95	Maximum Half-hourly average	8	11	9	9	12	44	11	16	10	7	6	42	21	37	11	21	44	15	28	95	20	17	12	9	8	25	38	42	10	11	10
	Monthly mean	7	Mean Half-hourly average	6	6	6	6	6	7	6	7	6	5	5	8	7	8	6	7	7	7	7	8	7	6	8	6	6	7	6	7	7	6	6
	Monthly minimum	2	Minimum Half-hourly average	4	2	4	3	2	4	4	4	4	3	3	4	5	4	4	4	4	4	3	3	2	3	4	5	4	3	2	3	3	3	4
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	8	Daily average	6	6	6	6	6	7	6	7	6	5	5	8	7	8	6	7	7	7	7	8	7	6	8	6	6	7	6	7	7	6	6
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 CO

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A2 For the month of February 2026

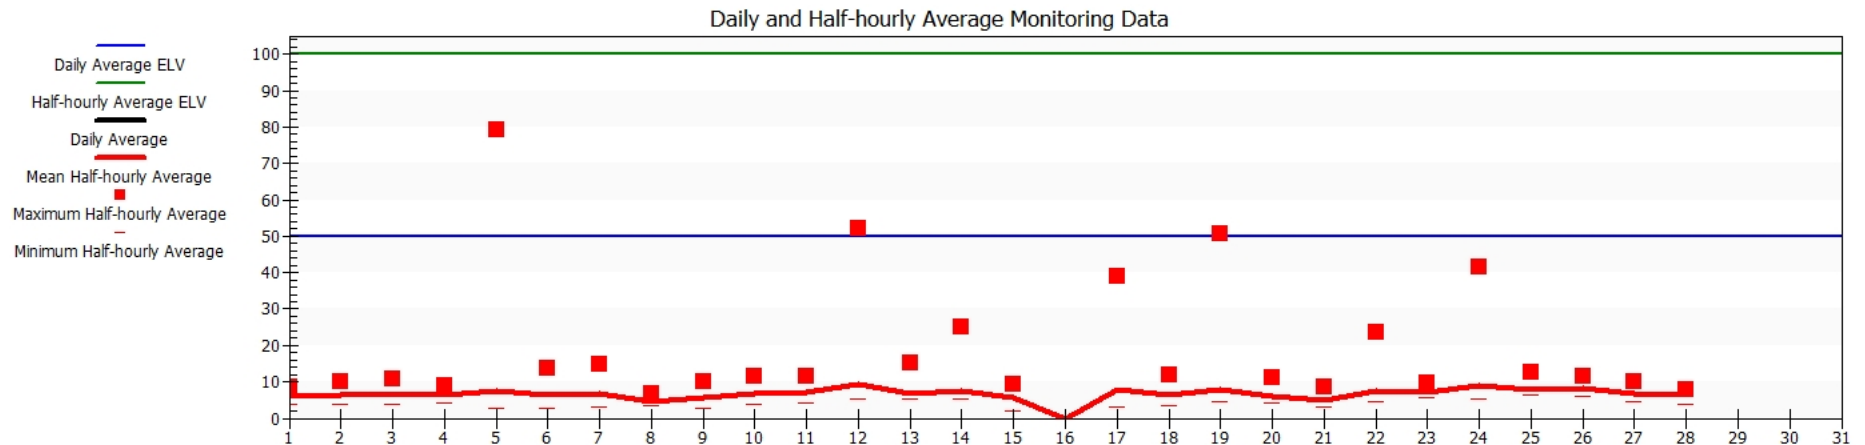

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100				
	Monthly maximum	79	Maximum Half-hourly average	9	10	11	9	79	14	15	7	10	12	12	52	15	25	9	Off	39	12	51	11	9	23	10	42	13	12	10	8				
	Monthly mean	7	Mean Half-hourly average	6	6	6	6	8	7	7	5	6	7	7	9	7	8	6	Off	8	6	8	6	5	8	7	9	8	8	7	6				
	Monthly minimum	2	Minimum Half-hourly average	4	4	4	4	3	3	3	3	3	4	4	5	5	5	2	Off	3	3	5	4	3	5	6	5	6	6	5	4				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50				
	Monthly maximum	9	Daily average	6	6	6	6	8	7	7	5	6	7	7	9	7	8	6	Off	8	6	8	6	5	8	7	9	8	8	7	6				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 CO

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A2 For the month of March 2026

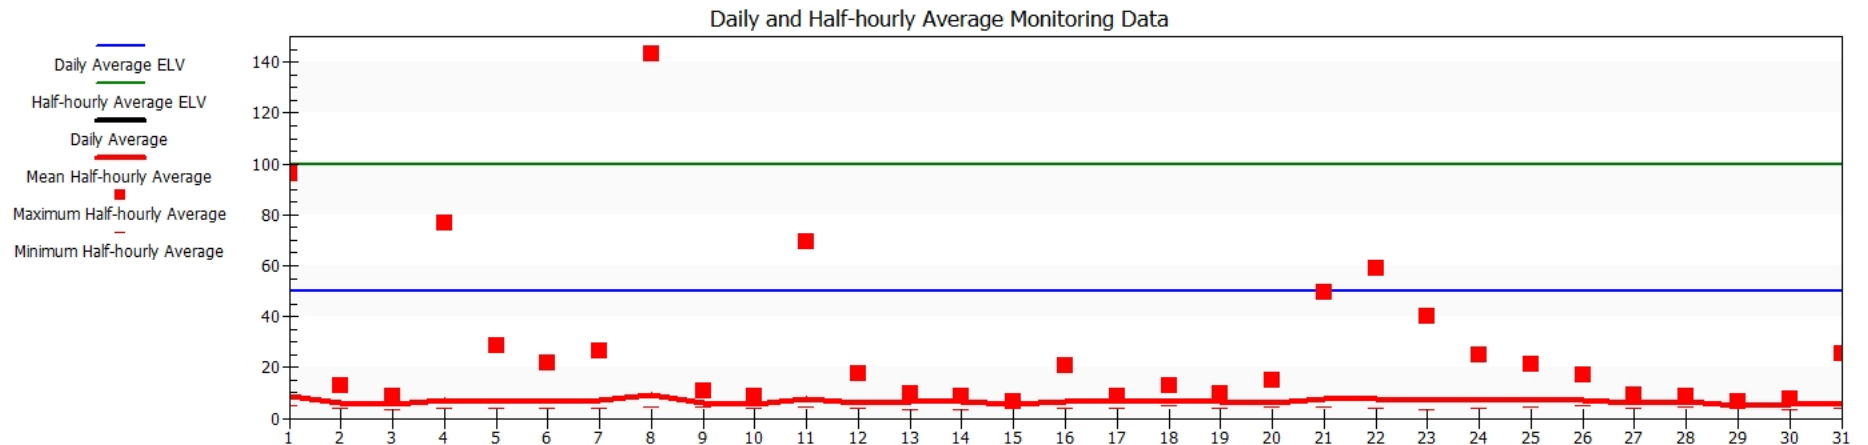

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Monthly maximum	143	Maximum Half-hourly average	96	13	9	77	29	22	26	143	11	9	70	17	10	9	6	21	9	13	10	15	50	59	40	25	21	17	9	9	7	7	25
	Monthly mean	7	Mean Half-hourly average	8	6	6	7	6	7	7	9	6	6	7	6	6	6	5	7	6	7	7	6	8	8	7	7	7	7	6	6	5	5	6
	Monthly minimum	3	Minimum Half-hourly average	5	4	4	4	4	4	4	4	4	4	5	4	4	4	4	4	4	5	4	4	4	4	4	4	4	5	4	4	4	3	4
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	1	No of exceedances of ELV	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	9	Daily average	8	6	6	7	6	7	7	9	6	6	7	6	6	6	5	7	6	7	7	6	8	8	7	7	7	7	6	6	5	5	6
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 HCl

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A2 For the month of January 2026

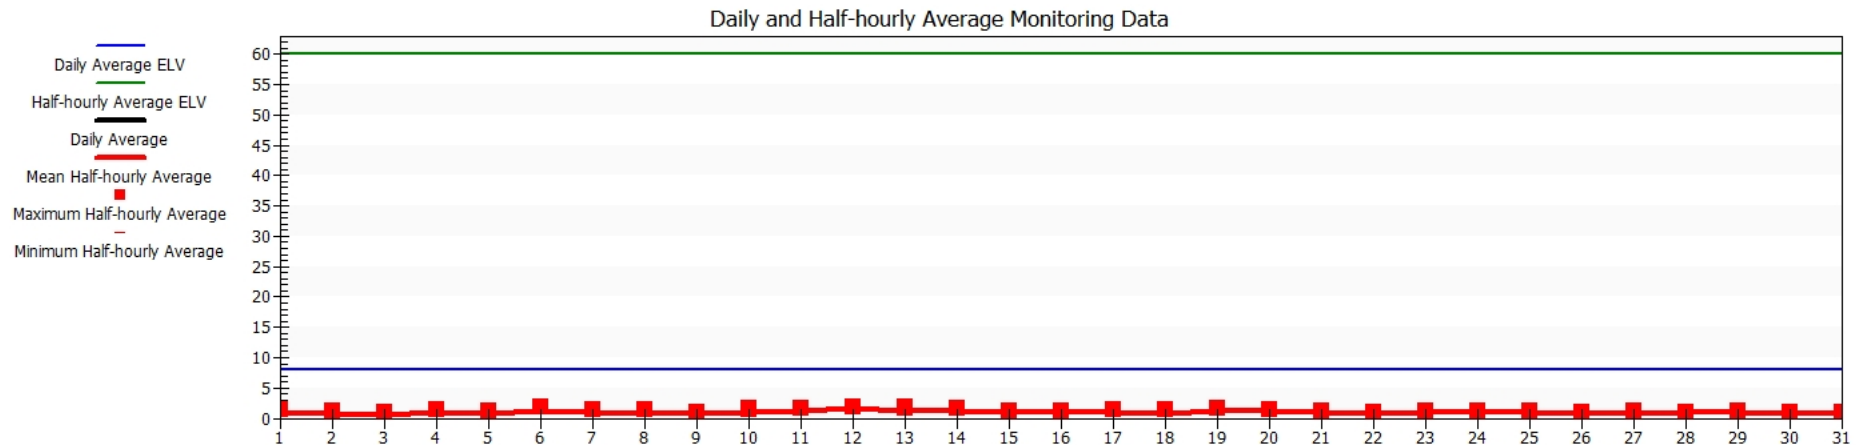

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	2	Maximum Half-hourly average	1	1	1	1	1	2	1	1	1	2	2	2	2	2	1	1	1	1	2	2	1	1	1	1	1	1	1	1	1	1	1
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Monthly minimum	0	Minimum Half-hourly average	1	0	0	0	0	1	1	0	0	0	1	1	1	1	1	1	1	0	1	1	1	1	1	1	1	0	1	1	1	1	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
	Monthly maximum	2	Daily average	1	1	1	1	1	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 HCl

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A2 For the month of February 2026

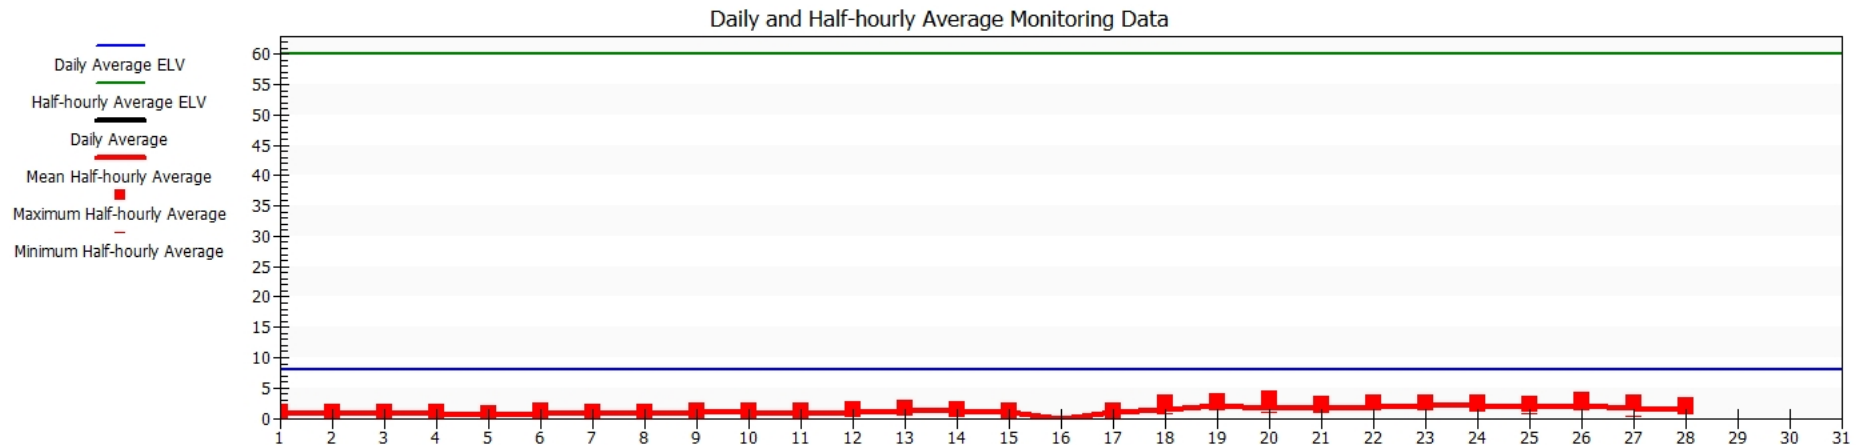

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60			
	Monthly maximum	3	Maximum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	2	1	1	Off	1	2	3	3	2	2	3	3	2	3	2	2			
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	Off	1	2	2	2	2	2	2	2	2	2	2	1			
	Monthly minimum	0	Minimum Half-hourly average	1	1	0	1	0	0	1	1	1	1	1	1	1	1	0	Off	0	1	1	1	1	1	2	1	1	1	0	1			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0			
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8			
	Monthly maximum	2	Daily average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	Off	1	2	2	2	2	2	2	2	2	2	2	1			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 HCI

Reporting of Continuously Monitored Emissions to Air for HCI mg/m3 at Emission Point A2 For the month of March 2026

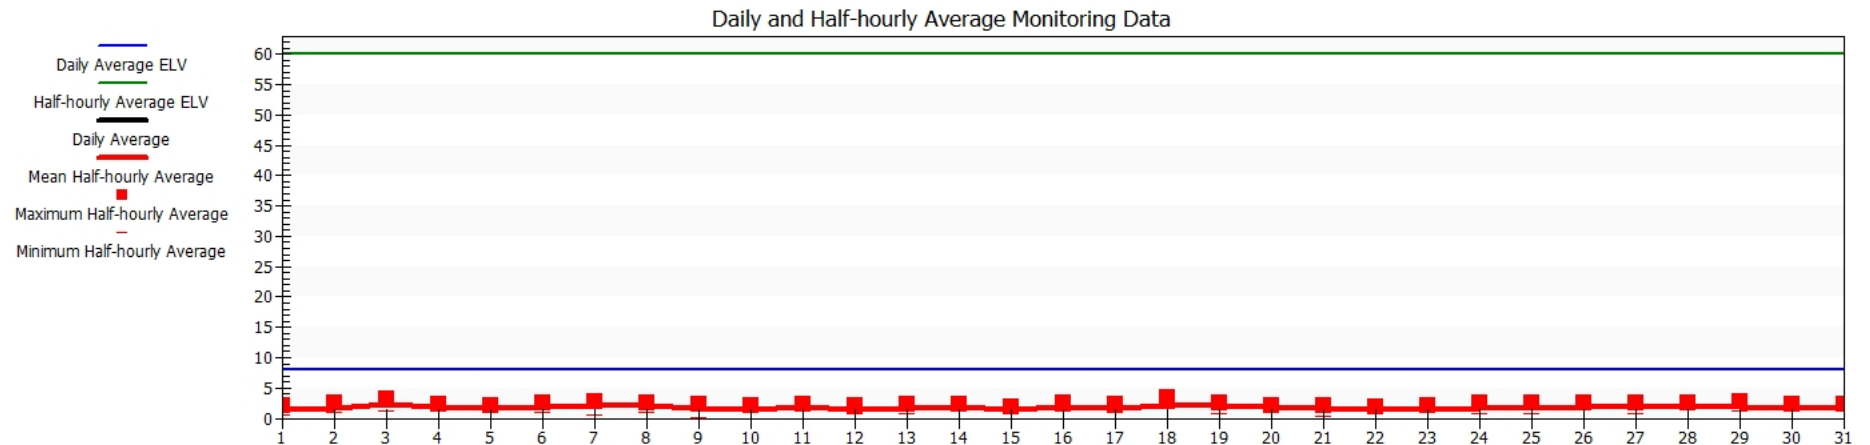

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	3	Maximum Half-hourly average	2	3	3	2	2	2	3	3	2	2	2	2	2	2	2	3	2	3	3	2	2	2	2	3	2	2	2	2	3	2	2
	Monthly mean	2	Mean Half-hourly average	1	2	2	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	2
	Monthly minimum	0	Minimum Half-hourly average	1	1	1	1	1	1	1	1	0	1	1	1	1	1	1	1	1	2	1	1	0	1	1	1	1	1	1	2	1	1	1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
	Monthly maximum	2	Daily average	1	2	2	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 SO2

Reporting of Continuously Monitored Emissions to Air for SO2 mg/m3 at Emission Point A2 For the month of January 2026

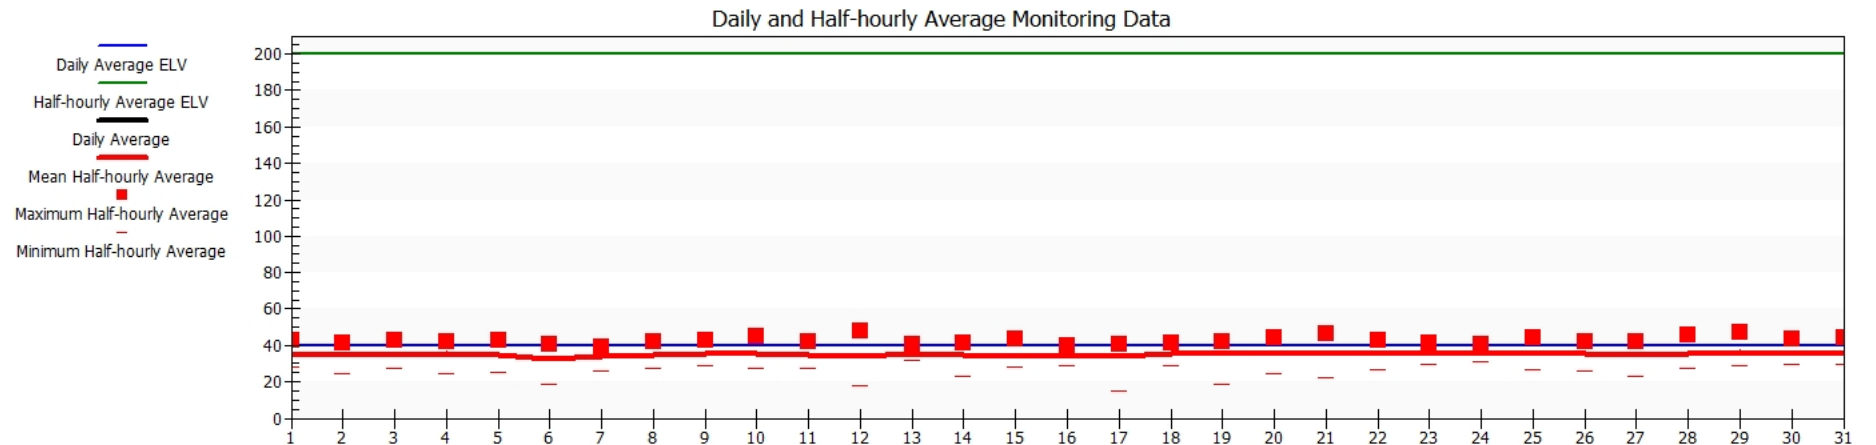

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	48	Maximum Half-hourly average	43	41	43	42	43	40	39	42	43	45	42	48	41	41	44	40	41	41	42	44	46	43	41	41	44	42	42	45	47	44	44
	Monthly mean	35	Mean Half-hourly average	35	35	35	35	35	32	34	35	36	36	35	34	35	35	34	35	34	36	35	36	36	36	36	36	36	35	35	36	36	36	36
	Monthly minimum	15	Minimum Half-hourly average	28	25	27	25	25	19	26	28	29	28	28	18	32	23	28	29	15	29	19	25	22	27	29	31	27	26	23	28	29	29	30
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	36	Daily average	35	35	35	35	35	32	34	35	36	36	35	34	35	35	34	35	34	36	35	36	36	36	36	36	36	35	35	36	36	36	36
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 SO2

Reporting of Continuously Monitored Emissions to Air for SO2 mg/m3 at Emission Point A2 For the month of February 2026

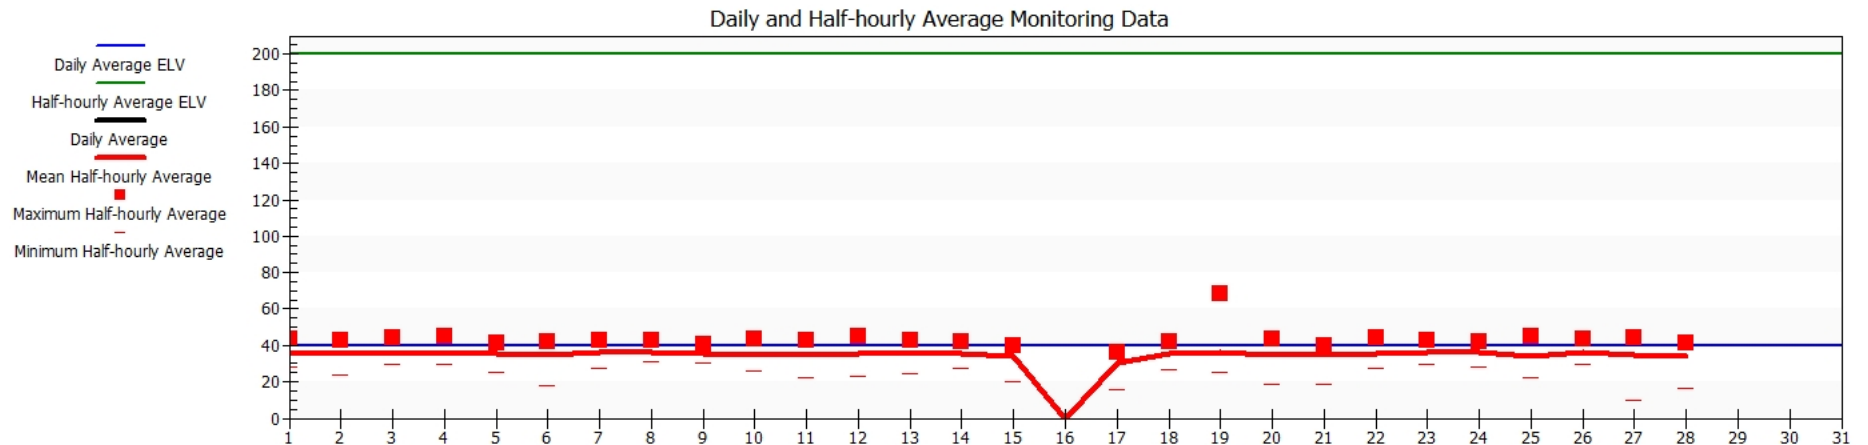

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200				
	Monthly maximum	68	Maximum Half-hourly average	44	43	44	45	41	42	43	43	41	43	43	45	43	42	40	Off	36	42	68	44	40	44	43	42	45	43	44	41				
	Monthly mean	35	Mean Half-hourly average	36	36	36	36	36	35	36	36	36	35	35	36	35	36	34	Off	30	36	36	34	35	36	36	36	34	36	35	34				
	Monthly minimum	10	Minimum Half-hourly average	28	24	29	30	25	18	27	31	30	26	22	23	24	28	20	Off	16	27	25	19	18	27	29	29	22	30	10	16				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40				
	Monthly maximum	36	Daily average	36	36	36	36	36	35	36	36	36	35	35	36	35	36	34	Off	30	36	36	34	35	36	36	36	34	36	35	34				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 SO2

Reporting of Continuously Monitored Emissions to Air for SO2 mg/m3 at Emission Point A2 For the month of March 2026

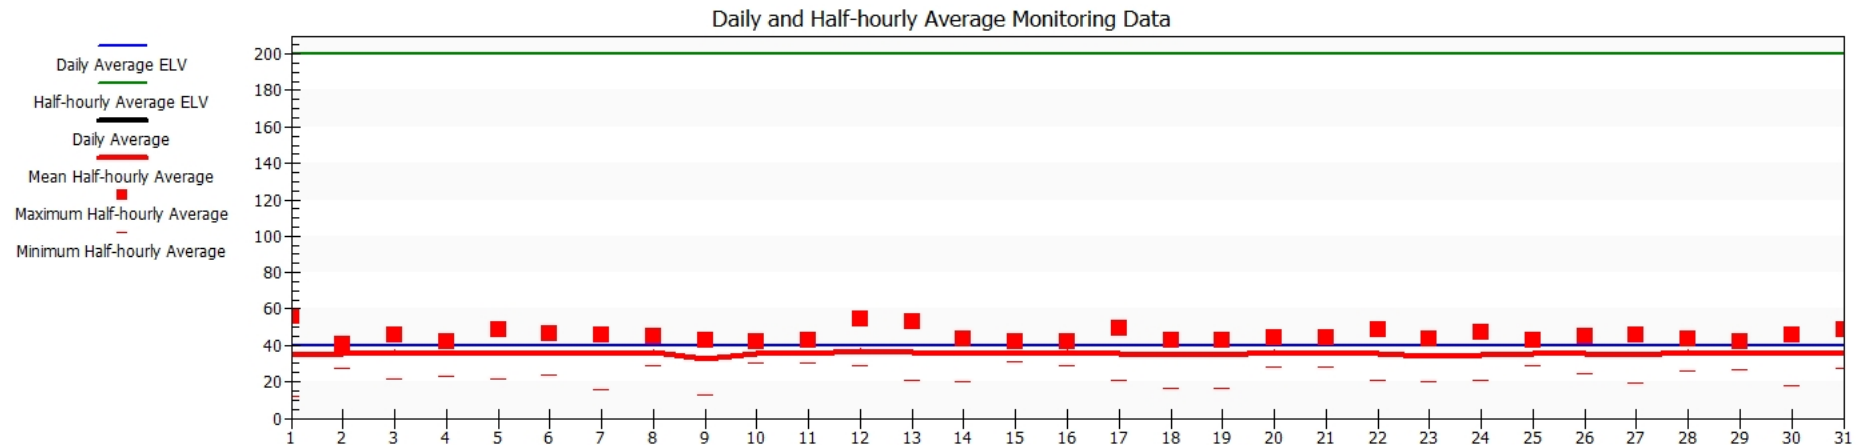

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	56	Maximum Half-hourly average	56	41	46	42	49	47	45	45	43	42	43	54	53	43	42	42	49	43	43	44	44	49	44	47	43	45	46	43	42	46	49
	Monthly mean	35	Mean Half-hourly average	34	36	36	35	36	36	36	36	33	36	36	37	36	36	36	36	35	35	35	36	36	35	34	35	36	36	35	36	36	36	36
	Monthly minimum	12	Minimum Half-hourly average	12	27	21	23	21	24	16	29	13	30	30	29	21	20	31	29	21	17	17	28	28	21	20	21	29	25	20	26	26	18	27
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	37	Daily average	34	36	36	35	36	36	36	36	33	36	36	37	36	36	36	36	35	35	35	36	36	35	34	35	36	36	35	36	36	36	36
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 VOC

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of January 2026

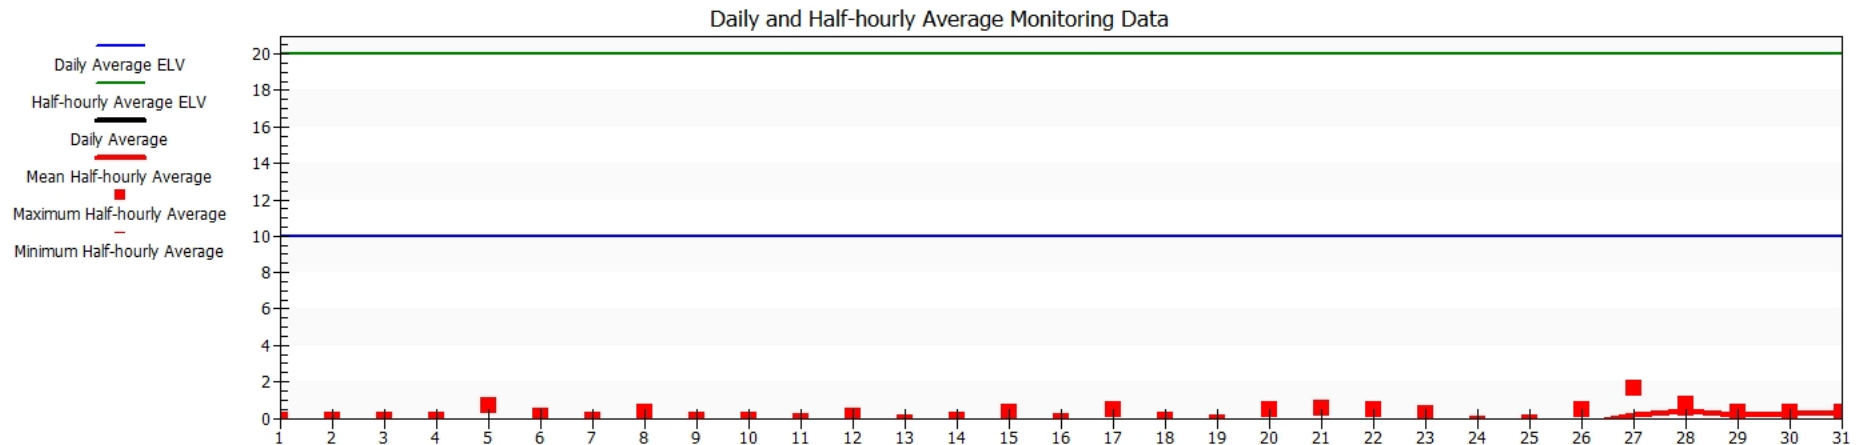

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	
	Monthly maximum	2	Maximum Half-hourly average	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	2	1	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 VOC

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of February 2026

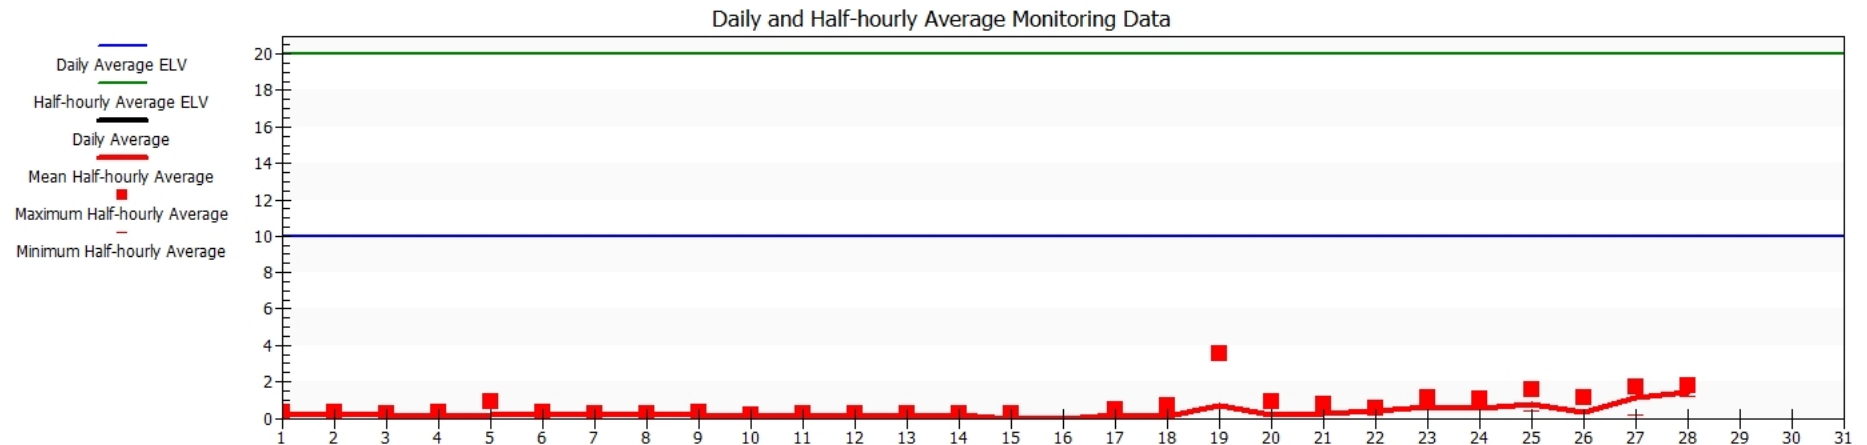

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20			
	Monthly maximum	4	Maximum Half-hourly average	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	Off	0	1	4	1	1	1	1	1	2	1	2	2			
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	1	0	0	0	1	1	1	0	1	1			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	1	0	0	0	0	0	0	0	0	0	1		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10			
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	1	0	0	0	1	1	1	0	1	1			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 VOC

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of March 2026

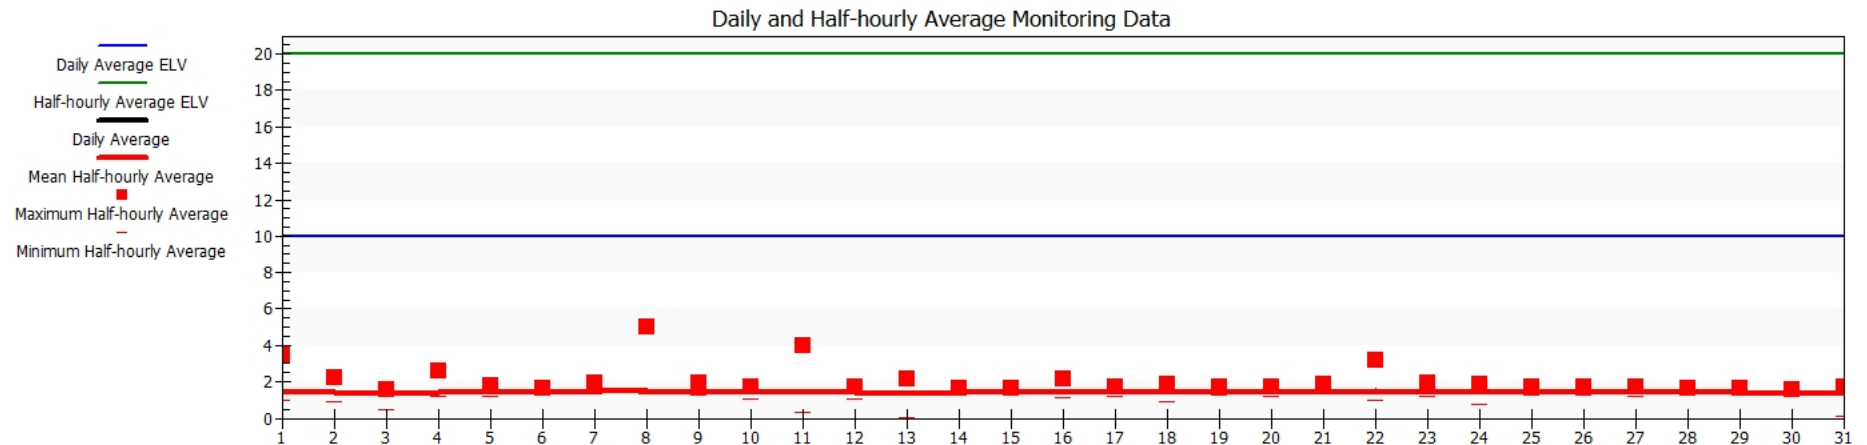

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
	Monthly maximum	5	Maximum Half-hourly average	3	2	2	3	2	2	2	5	2	2	4	2	2	2	2	2	2	2	2	2	2	3	2	2	2	2	2	2	2	2	2
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Monthly minimum	0	Minimum Half-hourly average	1	1	0	1	1	1	1	1	1	1	0	1	0	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	2	Daily average	1	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 PM

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A2 For the month of January 2026

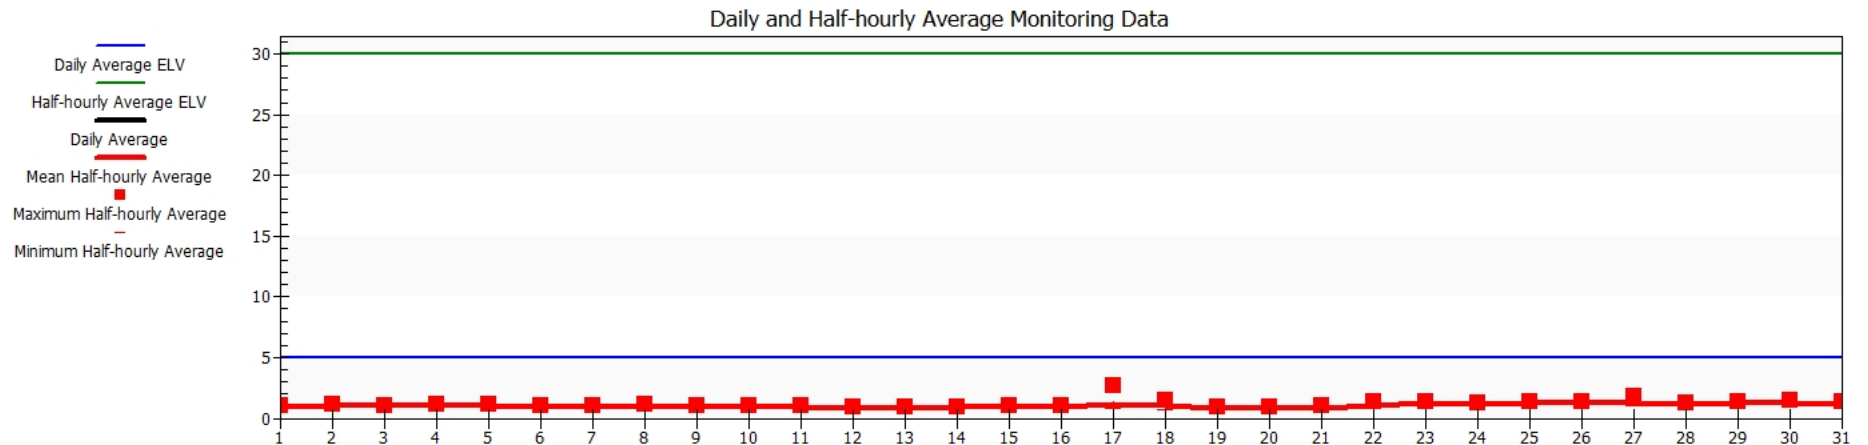

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	3	Maximum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	3	1	1	1	1	1	1	1	1	1	2	1	1	1	1
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Monthly minimum	1	Minimum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	Monthly maximum	1	Daily average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 PM

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A2 For the month of February 2026

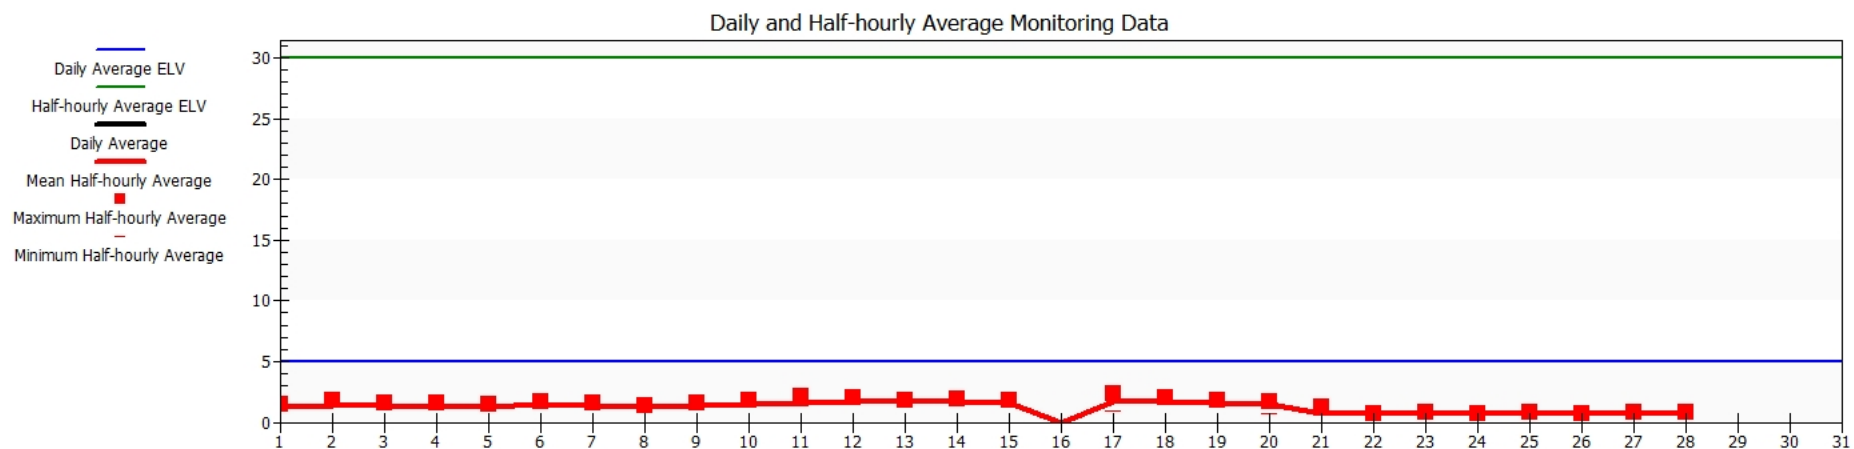

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30					
	Monthly maximum	2	Maximum Half-hourly average	1	2	2	2	1	2	2	1	2	2	2	2	2	2	2	Off	2	2	2	2	1	1	1	1	1	1	1	1				
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	1	2	2	2	2	2	Off	2	2	2	1	1	1	1	1	1	1	1	1				
	Monthly minimum	1	Minimum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	2	1	1	Off	1	1	1	1	1	1	1	1	1	1	1	1				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5			
	Monthly maximum	2	Daily average	1	1	1	1	1	1	1	1	1	1	2	2	2	2	2	Off	2	2	2	1	1	1	1	1	1	1	1	1				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number: L1 PM

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A2 For the month of March 2026

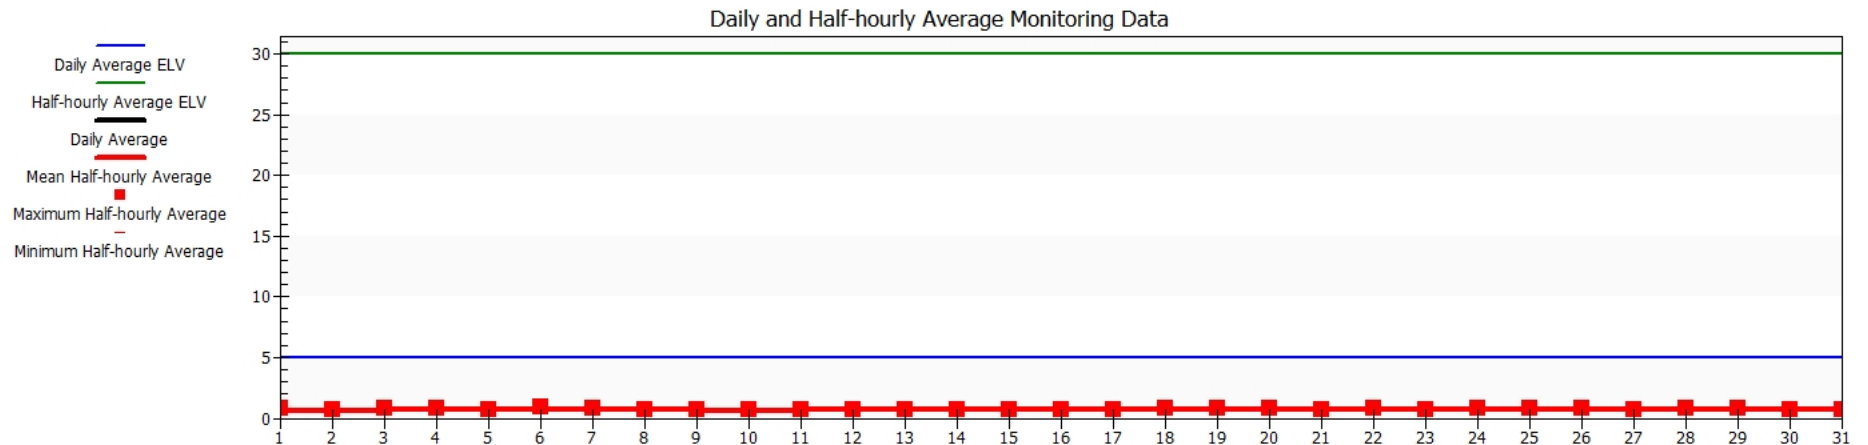

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	1	Maximum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Monthly minimum	1	Minimum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	Monthly maximum	1	Daily average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A2 For the month of January 2026

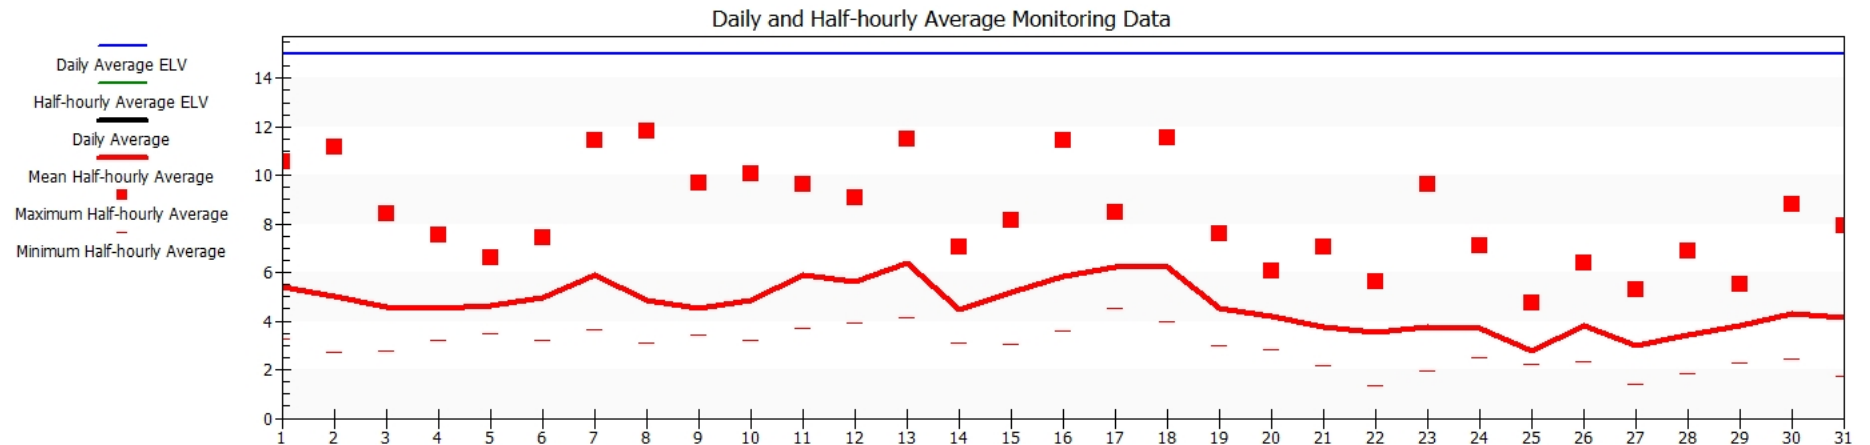

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	12	Maximum Half-hourly average	11	11	8	8	7	7	11	12	10	10	10	9	11	7	8	11	8	12	8	6	7	6	10	7	5	6	5	7	6	9	8
	Monthly mean	5	Mean Half-hourly average	5	5	5	5	5	5	6	5	5	5	6	6	6	4	5	6	6	6	5	4	4	4	4	4	3	4	3	3	4	4	4
	Monthly minimum	1	Minimum Half-hourly average	3	3	3	3	3	3	4	3	3	3	4	4	4	3	3	4	5	4	3	3	2	1	2	3	2	2	1	2	2	2	2
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15
	Monthly maximum	6	Daily average	5	5	5	5	5	5	6	5	5	5	6	6	6	4	5	6	6	6	5	4	4	4	4	4	3	4	3	3	4	4	4
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A2 For the month of February 2026

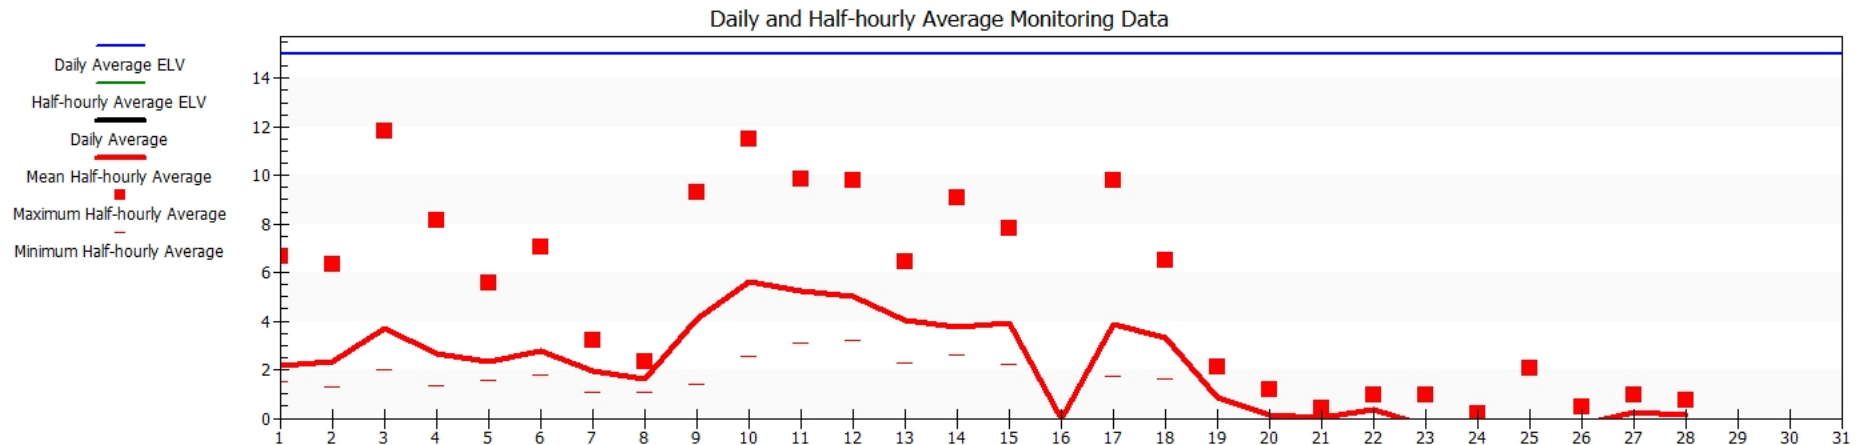

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A				
	Monthly maximum	12	Maximum Half-hourly average	7	6	12	8	6	7	3	2	9	11	10	10	6	9	8	Off	10	7	2	1	0	1	1	0	2	0	1	1				
	Monthly mean	2	Mean Half-hourly average	2	2	4	3	2	3	2	2	4	6	5	5	4	4	4	Off	4	3	1	0	0	0	0	0	0	0	0	0				
	Monthly minimum	0	Minimum Half-hourly average	2	1	2	1	2	2	1	1	1	3	3	3	2	3	2	Off	2	2	0	0	0	0	0	0	0	0	0	0				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A		
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15				
	Monthly maximum	6	Daily average	2	2	4	3	2	3	2	2	4	6	5	5	4	4	4	Off	4	3	1	0	0	0	0	0	0	0	0	0				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A2 For the month of March 2026

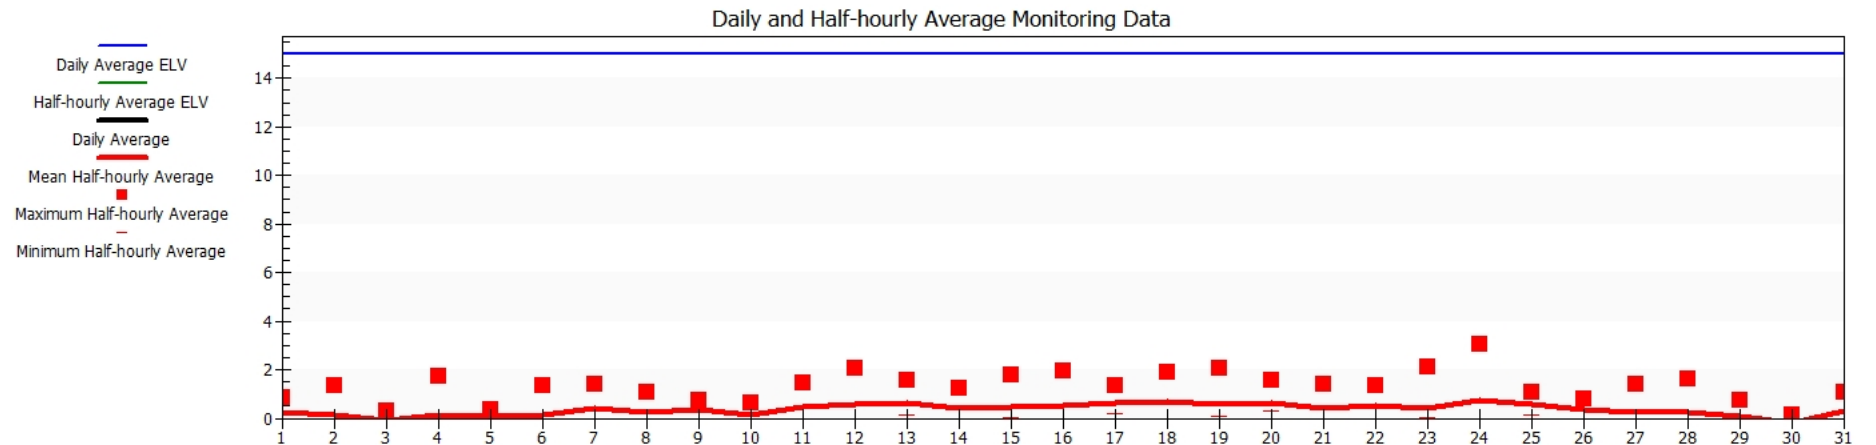

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	3	Maximum Half-hourly average	1	1	0	2	0	1	1	1	1	1	1	2	2	1	2	2	1	2	2	2	1	1	2	3	1	1	1	2	1	0	1
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	1	1	1	1	1	0	1	0	1	1	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	1	1	1	1	1	0	1	0	1	1	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)