


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A3 For the month of January 2026

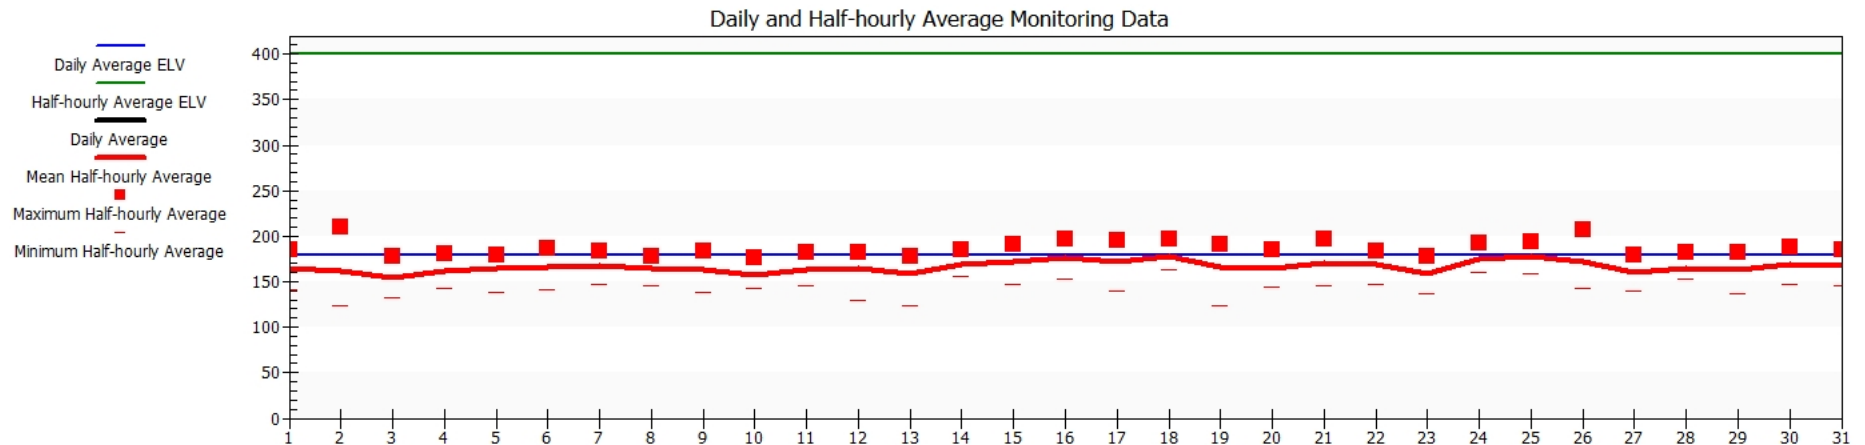

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	210	Maximum Half-hourly average	185	210	177	181	180	187	183	178	184	177	182	182	178	185	191	196	195	197	191	185	197	184	178	192	193	208	179	182	182	188	185
	Monthly mean	166	Mean Half-hourly average	164	162	155	162	165	167	167	164	162	158	164	165	158	170	172	176	172	178	166	164	170	169	159	175	178	172	160	164	163	169	167
	Monthly minimum	123	Minimum Half-hourly average	141	124	133	143	139	141	148	145	138	143	146	130	124	157	147	153	140	163	123	145	145	147	136	160	158	143	140	152	137	147	145
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	178	Daily average	164	162	155	162	165	167	167	164	162	158	164	165	158	170	172	176	172	178	166	164	170	169	159	175	178	172	160	164	163	169	167
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NO_x mg/m³ at Emission Point A3 For the month of February 2026

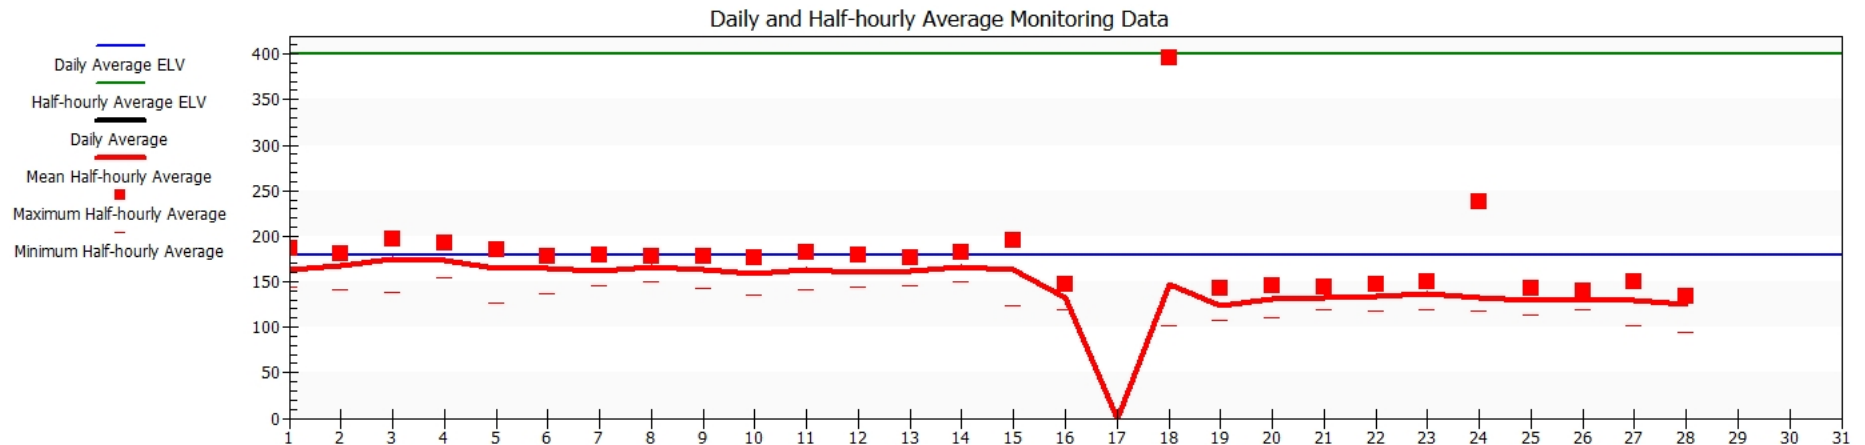

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400				
	Monthly maximum	395	Maximum Half-hourly average	187	181	197	193	186	178	180	179	177	176	182	179	177	182	195	147	Off	395	142	145	145	147	150	237	142	140	150	135				
	Monthly mean	150	Mean Half-hourly average	163	167	175	173	165	165	162	166	163	159	163	160	162	166	163	132	Off	147	124	132	132	134	136	132	130	131	129	126				
	Monthly minimum	94	Minimum Half-hourly average	145	141	139	155	126	136	146	150	143	136	142	144	145	151	124	119	Off	102	108	111	120	117	120	117	113	119	102	94				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180				
	Monthly maximum	175	Daily average	163	167	175	173	165	165	162	166	163	159	163	160	162	166	163	132	Off	147	124	132	132	134	136	132	130	131	129	126				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A3 For the month of March 2026

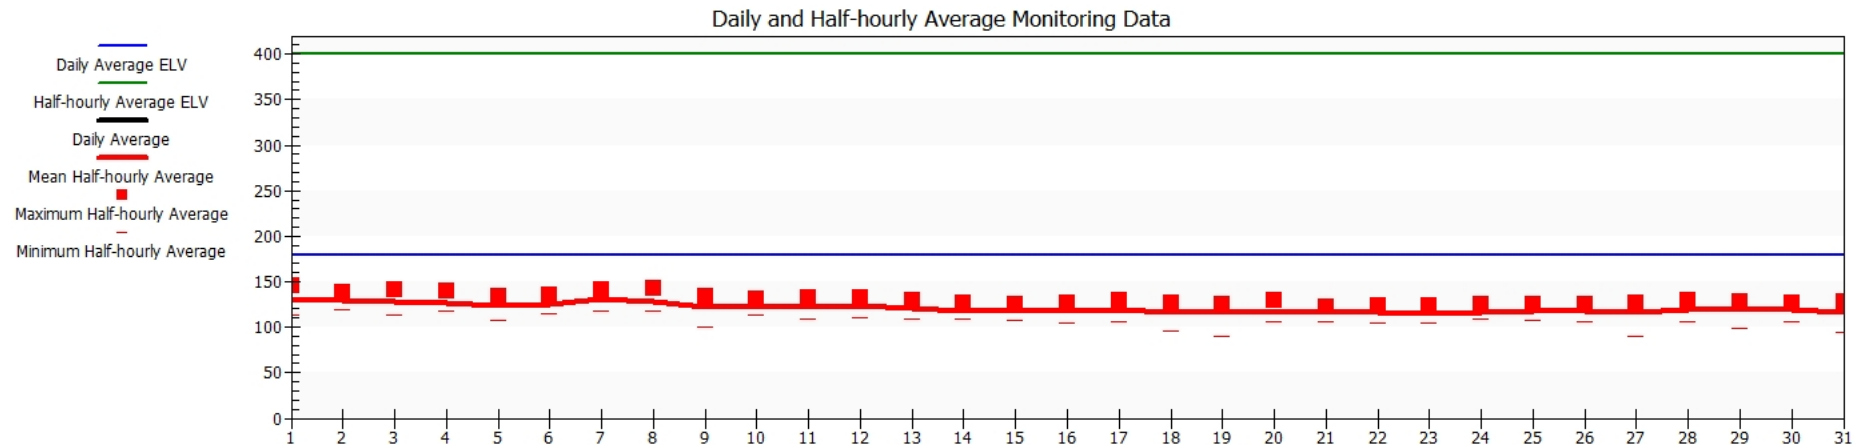

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	145	Maximum Half-hourly average	145	138	141	140	135	135	141	143	133	132	133	132	130	127	125	127	129	127	124	129	123	123	124	125	125	125	126	129	128	126	128
	Monthly mean	121	Mean Half-hourly average	131	129	129	126	123	125	130	128	122	123	123	123	121	119	118	118	119	117	116	116	117	117	115	117	118	117	117	119	119	119	116
	Monthly minimum	90	Minimum Half-hourly average	113	119	114	117	108	115	118	118	100	113	109	111	108	109	108	105	106	96	90	105	105	105	105	109	108	107	90	107	99	106	95
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	131	Daily average	131	129	129	126	123	125	130	128	122	123	123	123	121	119	118	118	119	117	116	116	117	117	115	117	118	117	117	119	119	119	116
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A3 For the month of January 2026

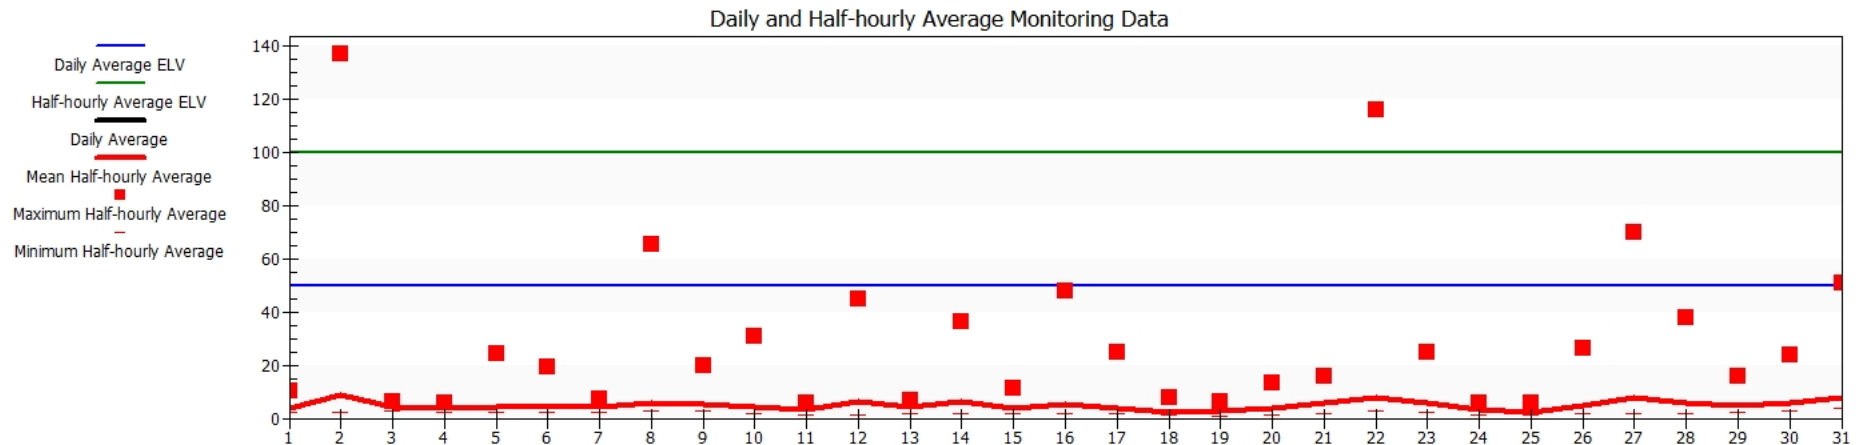

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Monthly maximum	137	Maximum Half-hourly average	10	137	6	6	24	19	7	66	20	31	6	45	7	36	11	48	25	8	6	13	16	116	25	6	6	26	70	38	16	24	51
	Monthly mean	5	Mean Half-hourly average	4	9	4	4	4	4	4	6	5	4	3	6	4	6	4	5	4	2	3	4	6	8	6	3	2	5	8	6	5	6	8
	Monthly minimum	1	Minimum Half-hourly average	2	2	3	2	2	2	2	3	3	2	1	1	2	2	2	2	2	1	1	1	2	3	2	1	1	2	2	2	2	3	4
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	2	No of exceedances of ELV	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	9	Daily average	4	9	4	4	4	4	4	6	5	4	3	6	4	6	4	5	4	2	3	4	6	8	6	3	2	5	8	6	5	6	8
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A3 For the month of February 2026

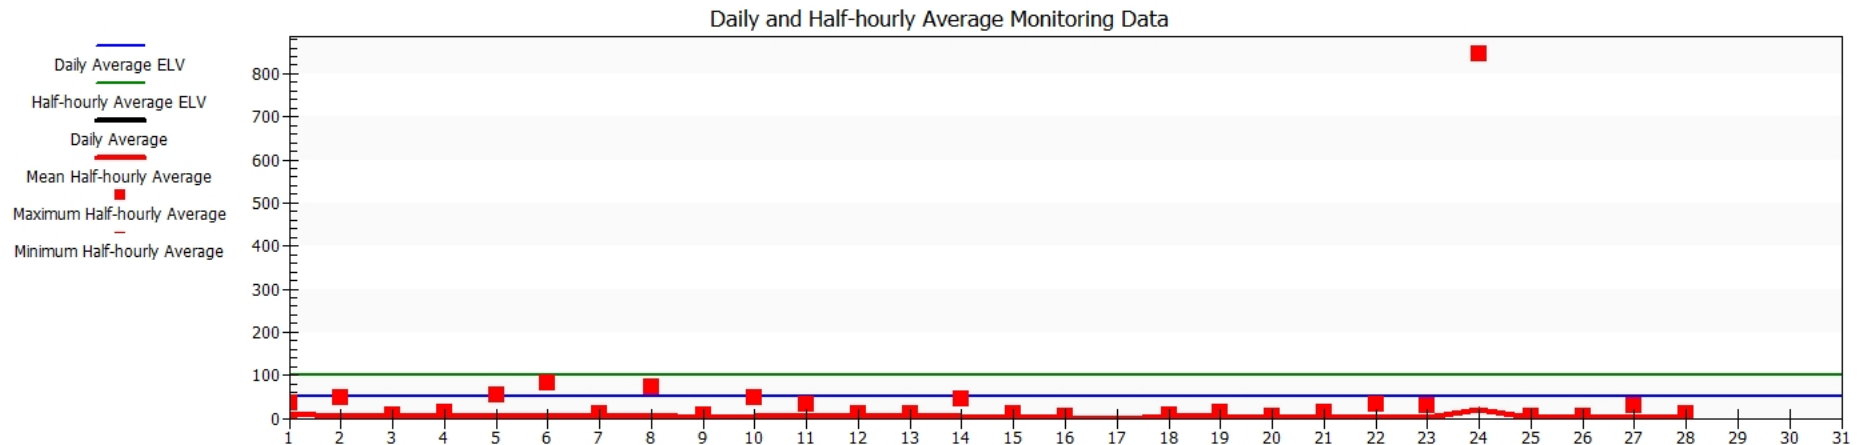

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100				31
	Monthly maximum	846	Maximum Half-hourly average	36	47	7	14	53	83	12	73	7	48	33	11	12	45	11	4	Off	8	13	6	13	34	29	846	4	5	29	10				
	Monthly mean	4	Mean Half-hourly average	10	6	3	4	4	7	4	7	3	6	6	5	5	5	3	3	Off	3	4	1	1	2	1	19	1	1	3	1				
	Monthly minimum	0	Minimum Half-hourly average	3	2	1	2	1	2	2	1	1	2	3	3	3	2	1	2	Off	0	0	0	0	0	0	0	0	0	0	0				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
	Sum of exceedances	1	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	1	0	0	0	0			
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50					
	Monthly maximum	19	Daily average	10	6	3	4	4	7	4	7	3	6	6	5	5	5	3	3	Off	3	4	1	1	2	1	19	1	1	3	1				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N				

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A3 For the month of March 2026

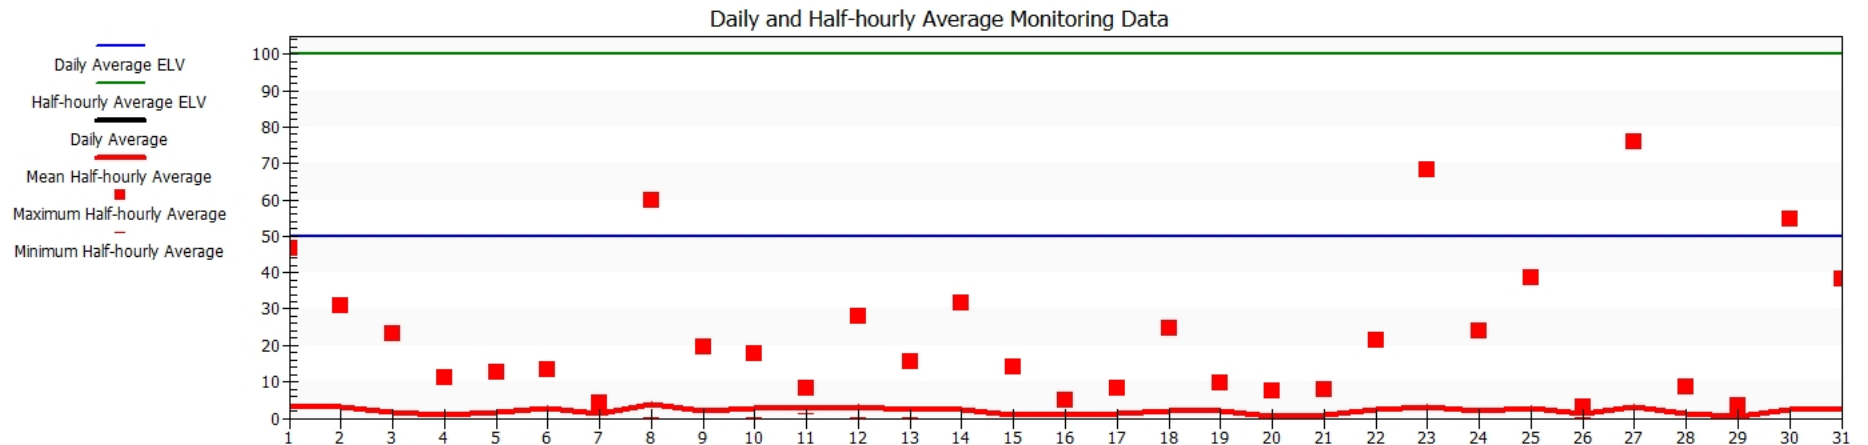

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Monthly maximum	76	Maximum Half-hourly average	47	31	23	11	13	13	4	60	20	18	8	28	16	32	14	5	8	25	10	8	8	21	68	24	39	3	76	9	4	55	38
	Monthly mean	2	Mean Half-hourly average	3	3	2	1	2	3	1	4	2	3	3	3	2	2	1	1	1	2	2	1	1	2	3	2	3	1	3	1	1	2	3
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	4	Daily average	3	3	2	1	2	3	1	4	2	3	3	3	2	2	1	1	1	2	2	1	1	2	3	2	3	1	3	1	1	2	3
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A3 For the month of January 2026

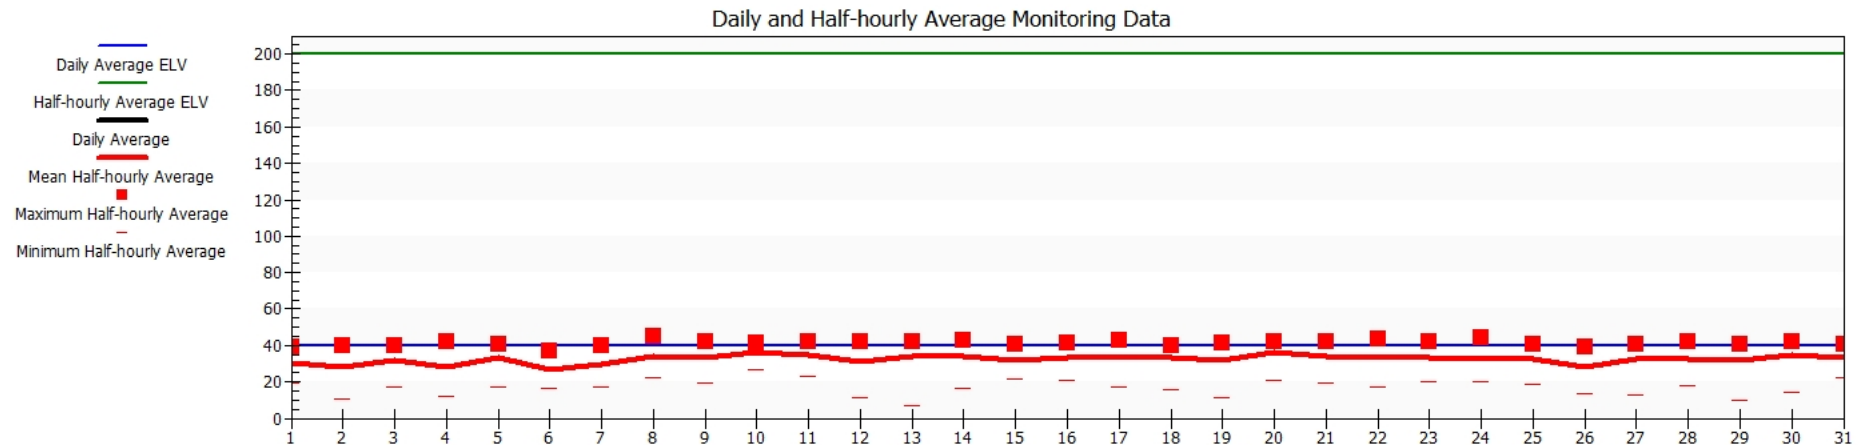

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	45	Maximum Half-hourly average	39	40	40	42	41	37	40	45	42	41	42	42	42	43	41	41	43	40	42	42	42	43	42	44	41	39	41	42	41	42	41
	Monthly mean	32	Mean Half-hourly average	30	28	32	28	33	27	30	34	33	36	35	31	34	34	32	33	34	34	32	36	34	33	34	33	32	28	33	33	32	35	33
	Monthly minimum	7	Minimum Half-hourly average	20	10	17	12	17	16	17	23	19	27	23	11	7	16	21	21	17	15	12	21	19	17	20	20	19	13	13	18	10	14	22
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	36	Daily average	30	28	32	28	33	27	30	34	33	36	35	31	34	34	32	33	34	34	32	36	34	33	34	33	32	28	33	33	32	35	33
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A3 For the month of February 2026

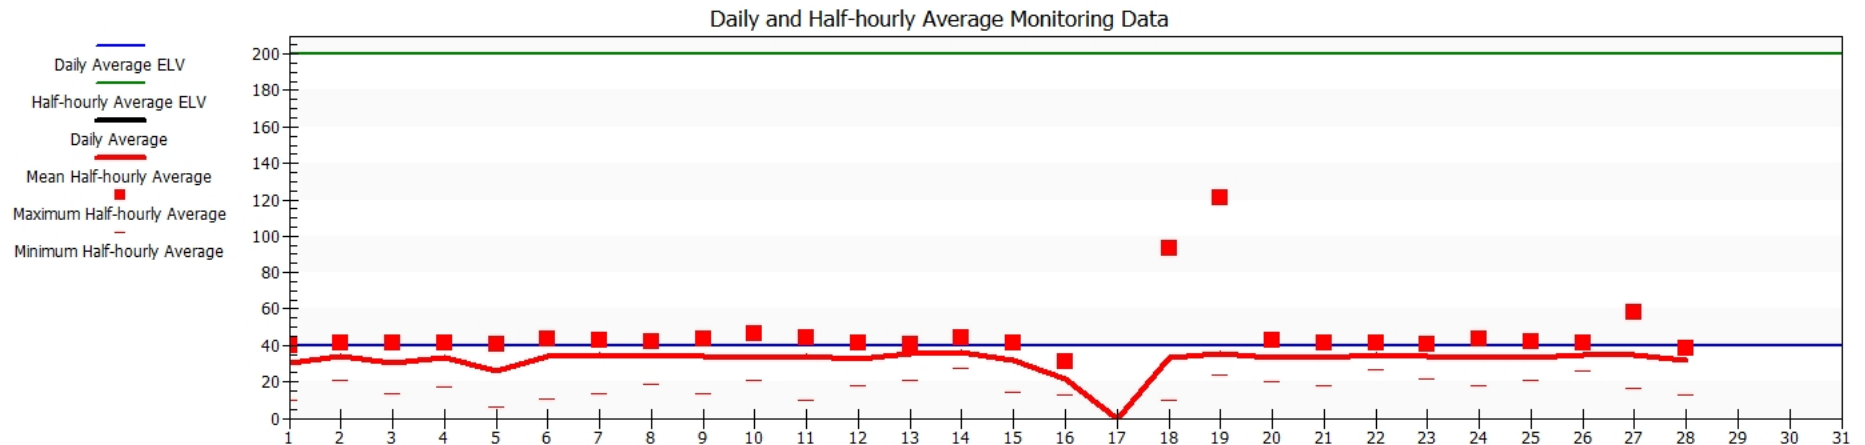

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200				
	Monthly maximum	121	Maximum Half-hourly average	40	41	42	41	40	44	42	42	43	46	44	41	41	44	41	31	Off	93	121	43	41	41	41	43	42	41	58	39				
	Monthly mean	33	Mean Half-hourly average	30	34	30	33	26	34	34	34	34	33	34	33	36	36	32	21	Off	33	35	34	34	34	34	33	33	35	35	32				
	Monthly minimum	6	Minimum Half-hourly average	10	21	14	17	6	10	13	19	14	21	10	18	21	27	14	13	Off	10	24	20	18	27	22	18	21	26	16	13				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			31
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0			
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40				
	Monthly maximum	36	Daily average	30	34	30	33	26	34	34	34	34	33	34	33	36	36	32	21	Off	33	35	34	34	34	34	33	33	35	35	32				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N				

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A3 For the month of March 2026

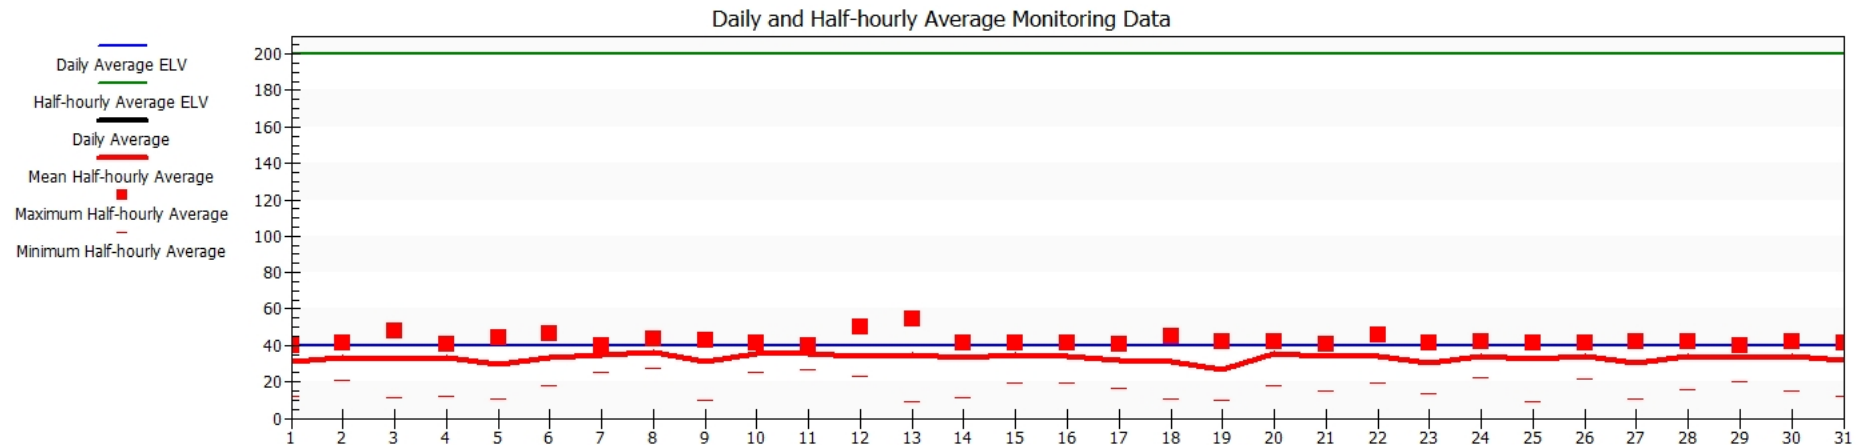

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	55	Maximum Half-hourly average	40	41	48	41	44	46	40	44	43	41	40	50	55	41	42	41	41	45	42	42	40	46	42	42	41	41	42	42	40	42	42
	Monthly mean	33	Mean Half-hourly average	31	33	32	33	29	33	35	37	31	36	35	34	35	33	35	34	32	31	27	35	34	34	31	34	33	34	31	34	34	32	
	Monthly minimum	9	Minimum Half-hourly average	12	21	11	12	11	18	25	28	10	25	27	23	9	11	19	20	16	10	10	18	15	20	14	23	9	21	10	16	20	15	12
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	37	Daily average	31	33	32	33	29	33	35	37	31	36	35	34	35	33	35	34	32	31	27	35	34	34	31	34	33	34	31	34	34	32	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A3 For the month of January 2026

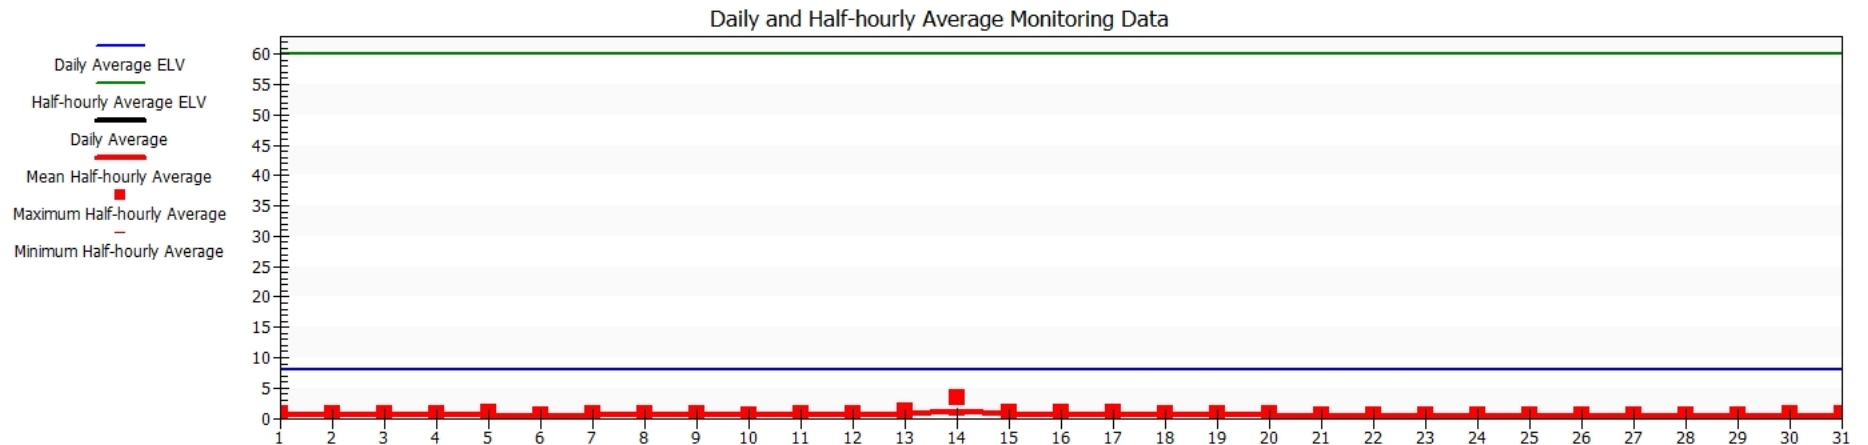

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	3	Maximum Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	3	1	1	1	1	1	1	1	1	1	1	1	1	0	1	1	1	1
	Monthly mean	1	Mean Half-hourly average	1	0	1	1	1	0	0	1	1	0	1	0	1	1	1	1	1	1	0	1	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
	Monthly maximum	1	Daily average	1	0	1	1	1	0	0	1	1	0	1	0	1	1	1	1	1	1	0	1	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A3 For the month of February 2026

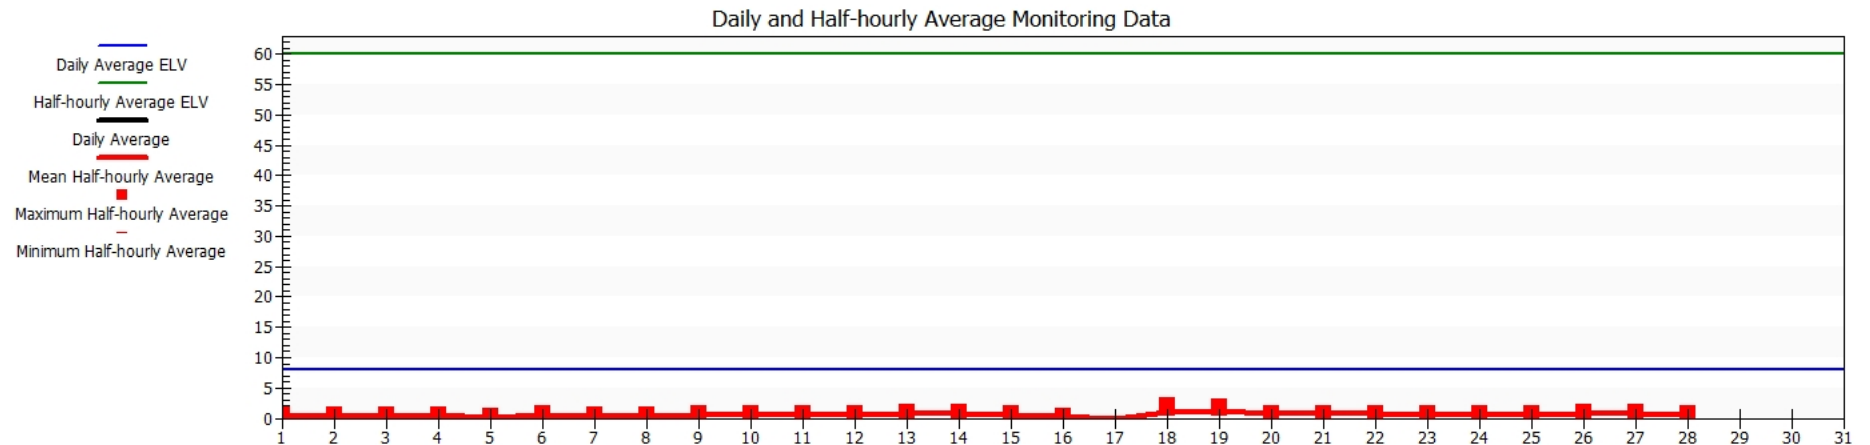

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60			
	Monthly maximum	2	Maximum Half-hourly average	0	1	1	1	0	1	1	1	1	1	1	1	1	1	1	0	Off	2	2	1	1	1	1	1	1	1	1	1			
	Monthly mean	1	Mean Half-hourly average	0	0	0	0	0	0	0	0	1	1	0	1	1	1	0	0	Off	1	1	1	1	1	1	1	1	1	1	1			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	Off	1	1	1	1	1	0	0	0	0	0	1	0		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8			
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	0	1	1	0	1	1	1	0	0	Off	1	1	1	1	1	1	1	1	1	1	1			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A3 For the month of March 2026

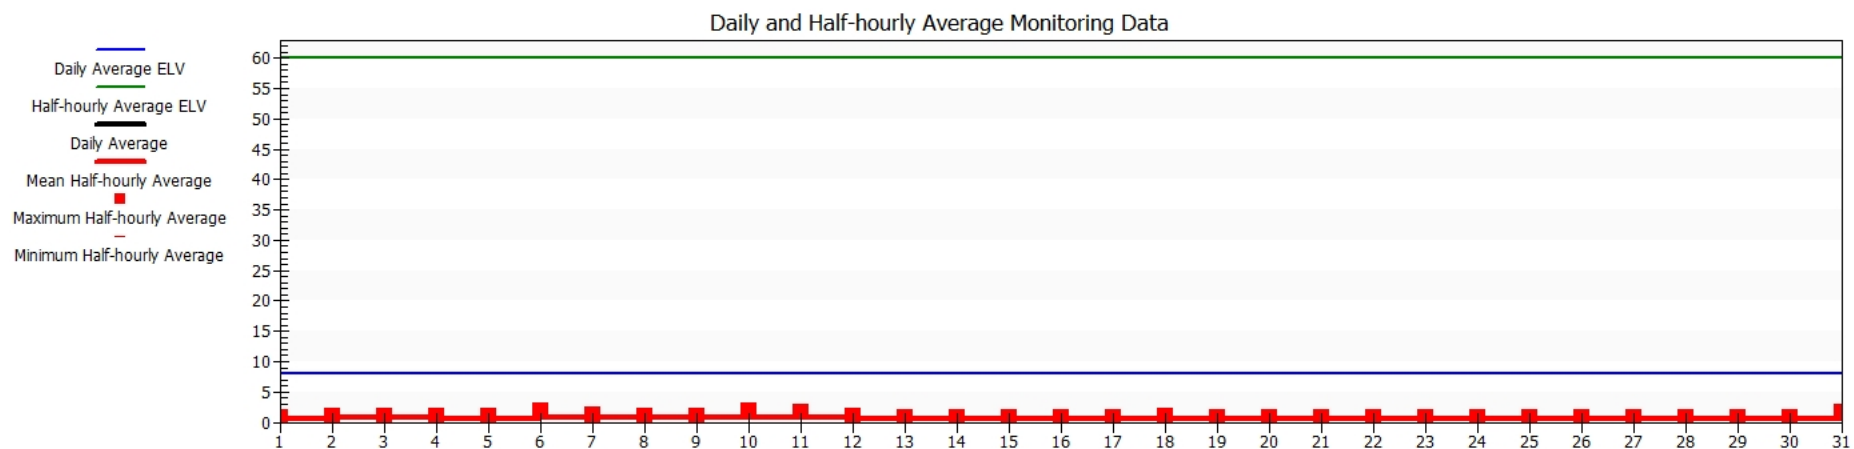

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	2	Maximum Half-hourly average	1	1	1	1	1	2	1	1	1	2	2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	2
	Monthly mean	1	Mean Half-hourly average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0	1	1	1	1	1	1	1	1	1	1	1	1
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	1	1	1	0	1	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
	Monthly maximum	1	Daily average	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0	1	1	1	1	1	1	1	1	1	1	1	1	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A3 For the month of January 2026

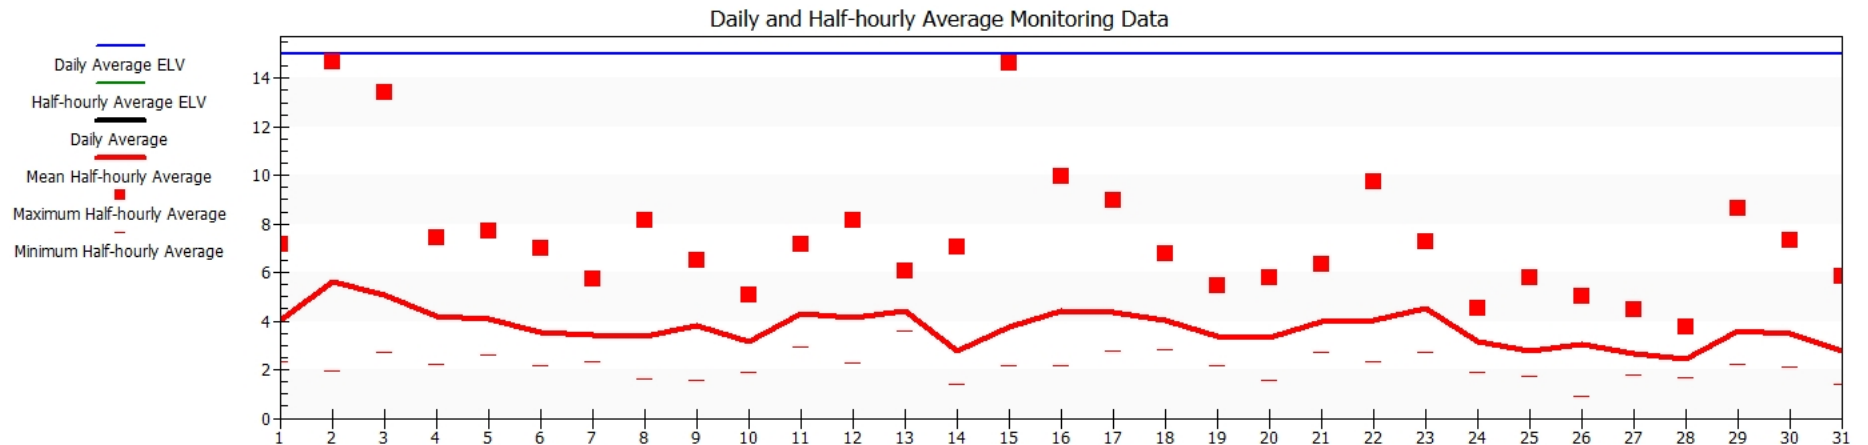

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	15	Maximum Half-hourly average	7	15	13	7	8	7	6	8	7	5	7	8	6	7	15	10	9	7	5	6	6	10	7	5	6	5	4	4	9	7	6
	Monthly mean	4	Mean Half-hourly average	4	6	5	4	4	4	3	3	4	3	4	4	4	3	4	4	4	4	3	3	4	4	5	3	3	3	3	2	4	3	3
	Monthly minimum	1	Minimum Half-hourly average	2	2	3	2	3	2	2	2	2	2	3	2	4	1	2	2	3	3	2	2	3	2	3	2	2	1	2	2	2	2	1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15
	Monthly maximum	6	Daily average	4	6	5	4	4	4	3	3	4	3	4	4	4	3	4	4	4	4	3	3	4	4	5	3	3	3	3	2	4	3	3
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A3 For the month of February 2026

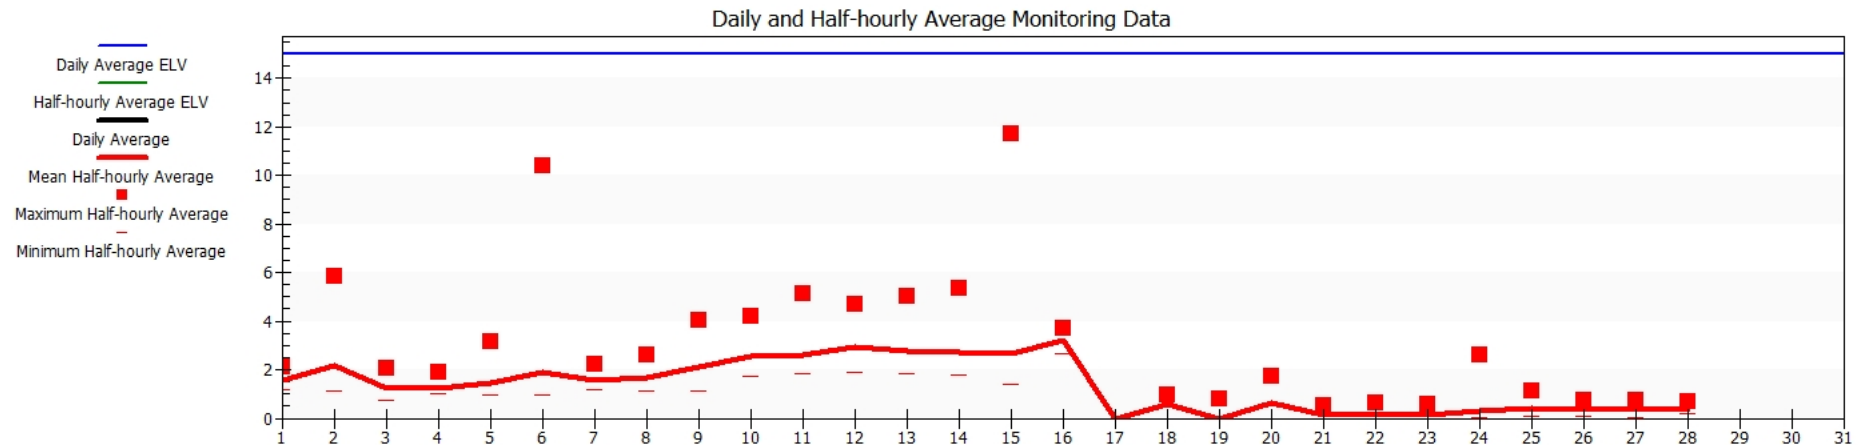

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A				
	Monthly maximum	12	Maximum Half-hourly average	2	6	2	2	3	10	2	3	4	4	5	5	5	5	12	4	Off	1	1	2	1	1	1	3	1	1	1	1				
	Monthly mean	1	Mean Half-hourly average	2	2	1	1	1	2	2	2	2	3	3	3	3	3	3	3	Off	1	0	1	0	0	0	0	0	0	0	0				
	Monthly minimum	0	Minimum Half-hourly average	1	1	1	1	1	1	1	1	1	2	2	2	2	2	1	3	Off	0	0	0	0	0	0	0	0	0	0	0				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A		
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15				
	Monthly maximum	3	Daily average	2	2	1	1	1	2	2	2	2	3	3	3	3	3	3	3	Off	1	0	1	0	0	0	0	0	0	0	0				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for NH3 mg/m3 at Emission Point A3 For the month of March 2026

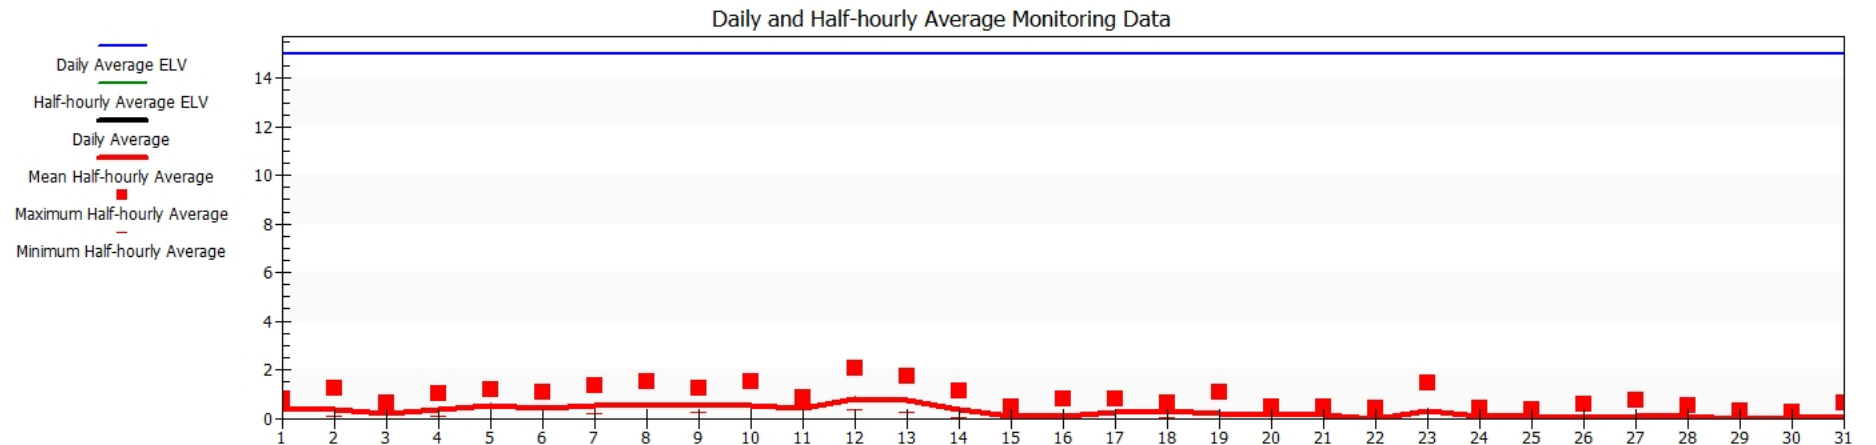

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	2	Maximum Half-hourly average	1	1	1	1	1	1	1	2	1	2	1	2	2	1	0	1	1	1	1	0	0	0	1	0	0	1	1	1	0	0	1
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	1	0	0	1	1	1	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15
	Monthly maximum	1	Daily average	0	0	0	0	1	0	0	1	1	1	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A3 For the month of January 2026

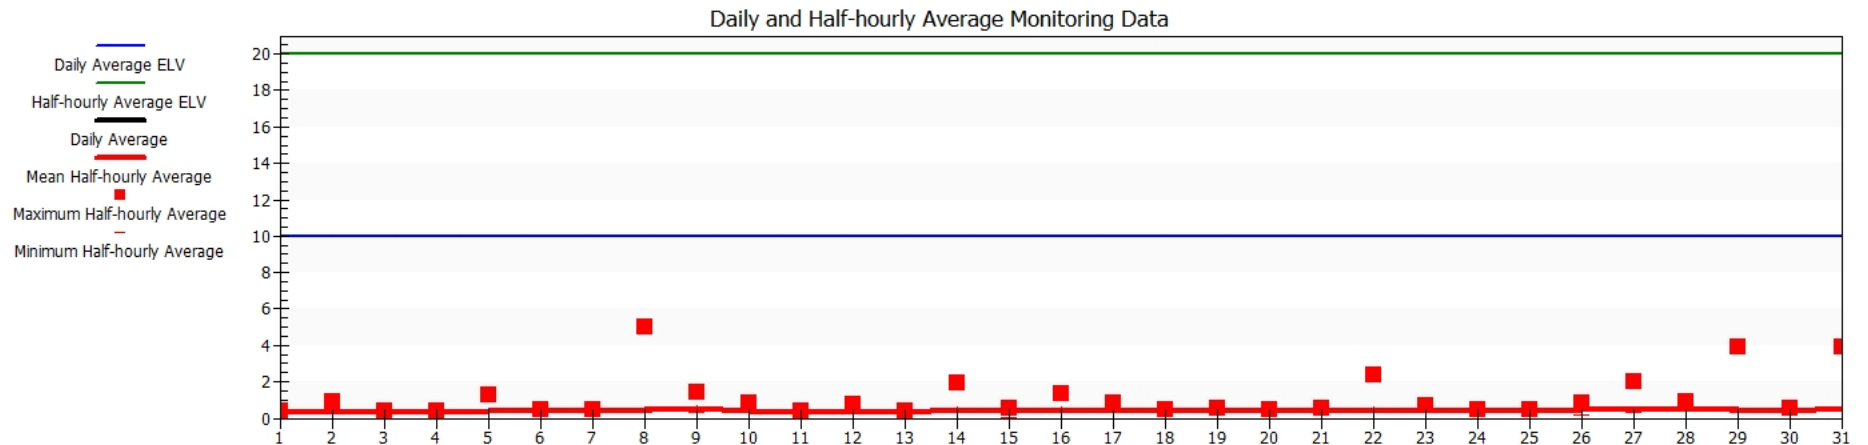

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
	Monthly maximum	5	Maximum Half-hourly average	0	1	0	0	1	0	0	5	1	1	0	1	0	2	1	1	1	0	1	0	1	2	1	0	0	1	2	1	4	1	4
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A3 For the month of February 2026

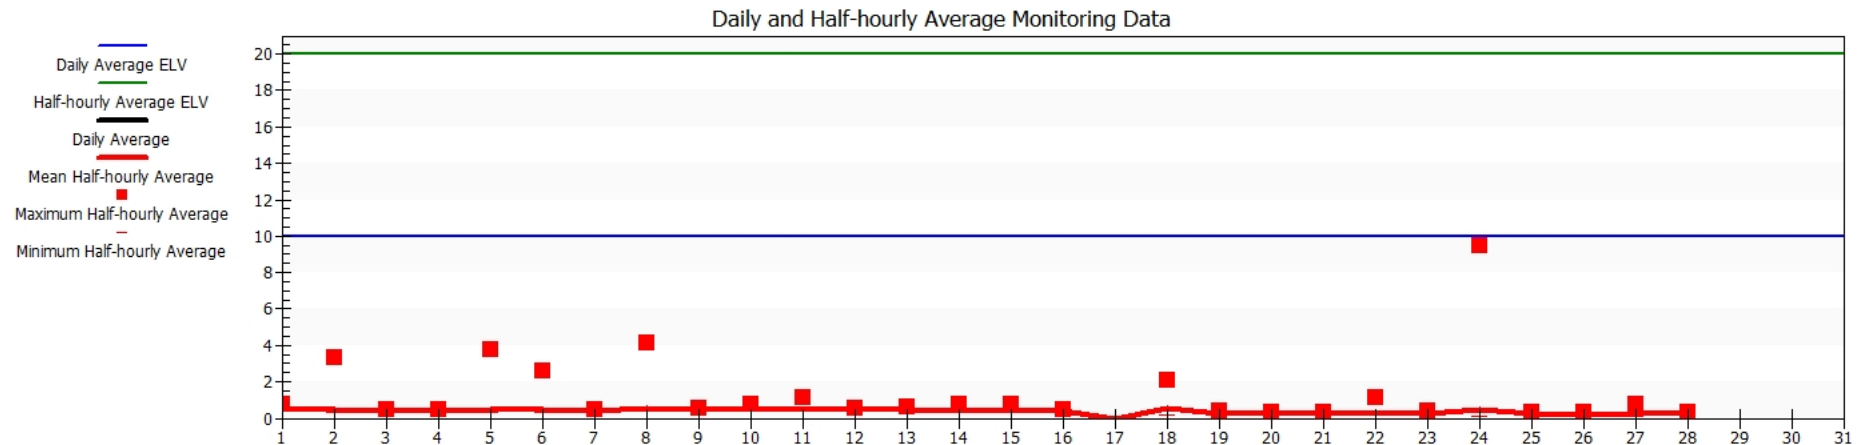

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20			
	Monthly maximum	9	Maximum Half-hourly average	1	3	0	0	4	3	0	4	1	1	1	1	1	1	1	0	Off	2	0	0	0	1	0	9	0	0	1	0			
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	Off	1	0	0	0	0	0	0	0	0	0	0			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0			
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10			
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	Off	1	0	0	0	0	0	0	0	0	0	0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A3 For the month of March 2026

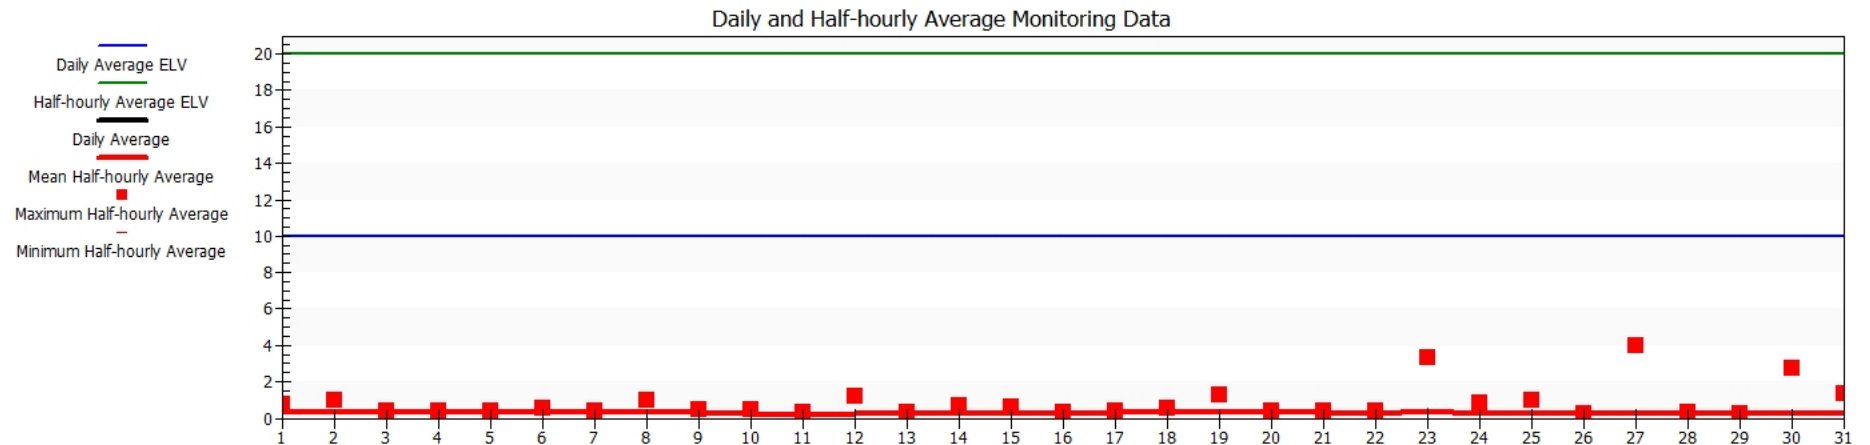

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
	Monthly maximum	4	Maximum Half-hourly average	1	1	0	0	0	1	0	1	0	0	0	1	0	1	1	0	0	1	1	0	0	0	3	1	1	0	4	0	0	3	1
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A3 For the month of January 2026

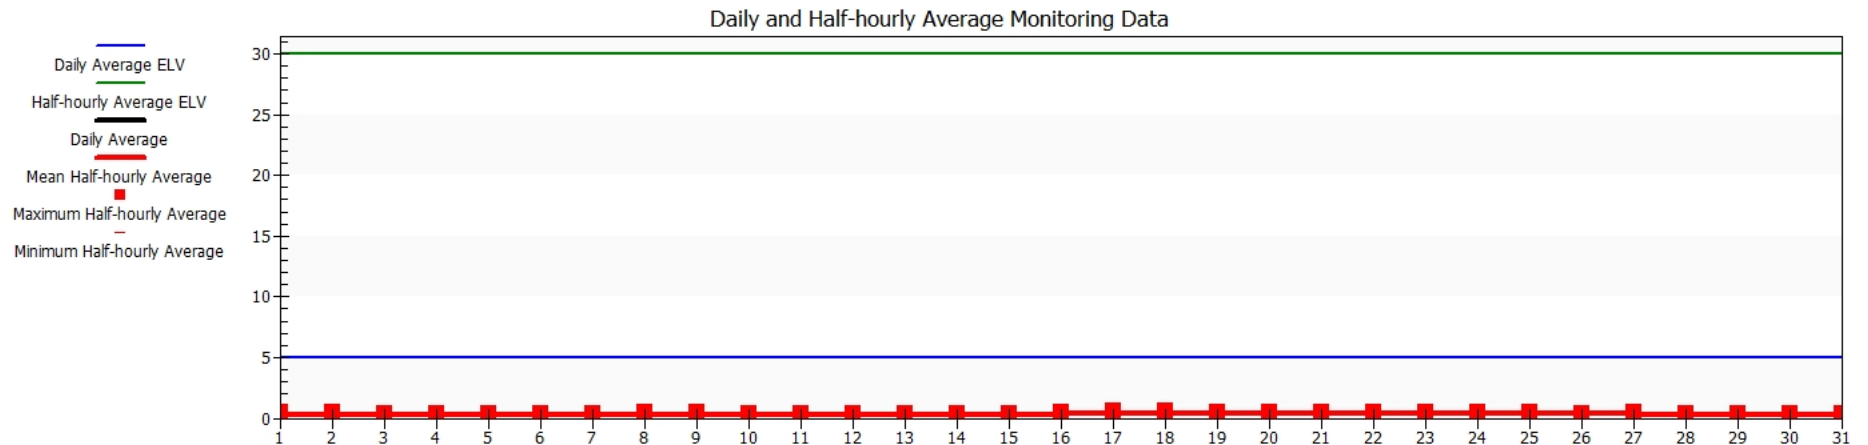

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	1	Maximum Half-hourly average	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	1	1	1	1	1	0	0	0	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A3 For the month of February 2026

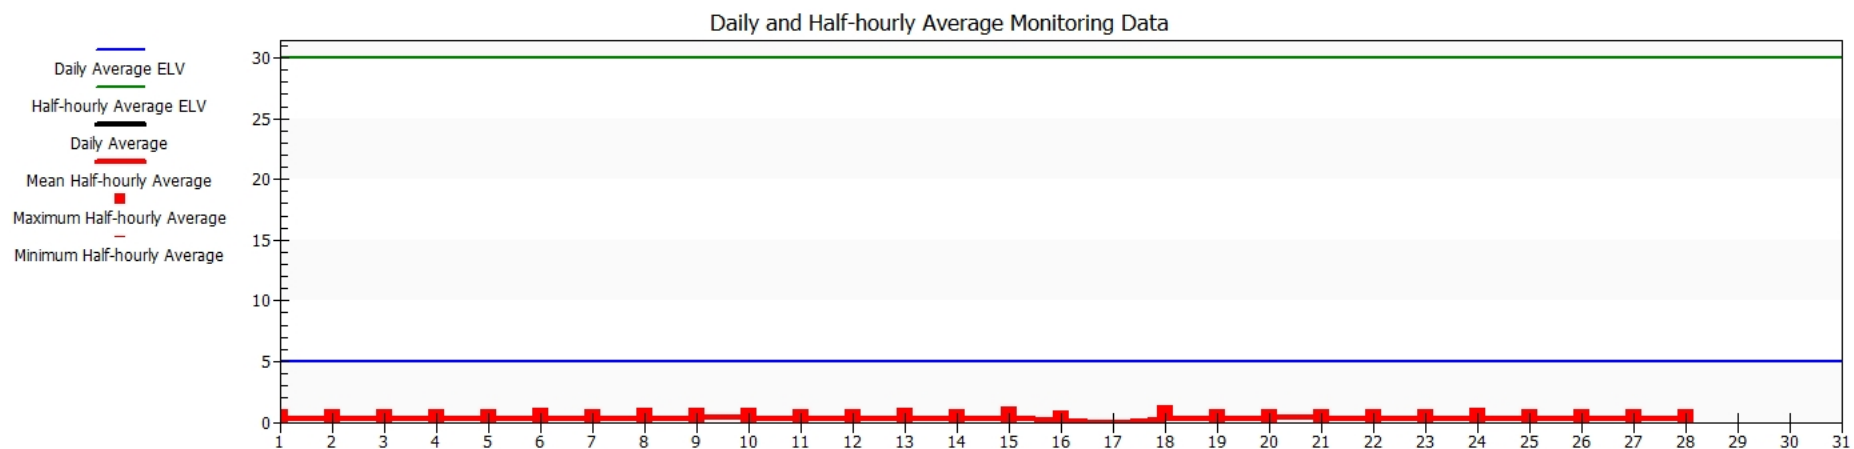

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30				
	Monthly maximum	1	Maximum Half-hourly average	0	0	0	0	0	1	0	0	1	0	0	0	0	0	1	0	Off	1	0	0	0	0	0	0	0	0	0	0			
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5			
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	0	0	0	0	0	0	0	0	0	0	0	0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : KP3808PN

Operator : Thalia AWRP ODC Limited

Installation: Allerton Waste Recovery Park

Form Number:

Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A3 For the month of March 2026

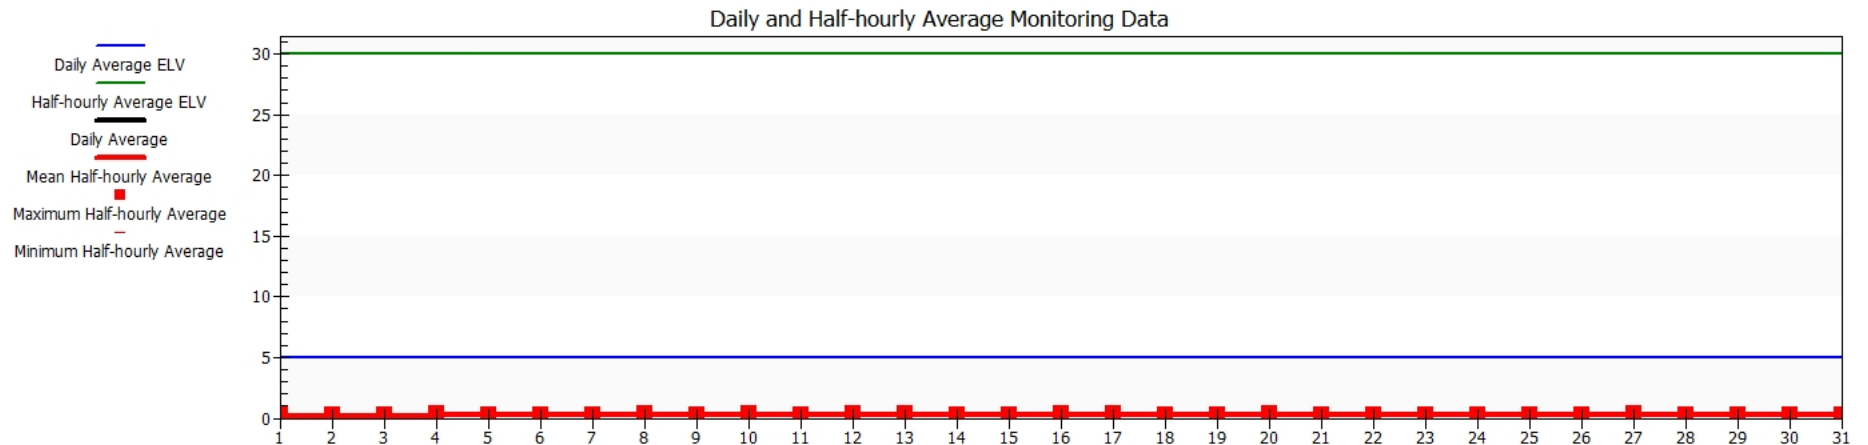

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	0	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)